




ArmorPoint 24V dc Output Modules, Series A


(Cat. No. 1738-OB8EM12, -OB8EM8, -OB4EM12, -OB4EM8, -OB2EM12, -OB2EPM12, -OV4EM12)

The ArmorPoint™ I/O family (Cat. no. 1738) consists of modular I/O modules. The sealed IP67 housing of these modules requires no enclosure. (Note that environmental requirements other than IP67 may require an additional appropriate housing.) I/O connectors are sealed M8 (pico) or M12 (micro) styles. The mounting base ships with the module. The 1738-OB8EM12 and 1738-OB8EM8 modules are shown below.

1738-OB8EM12

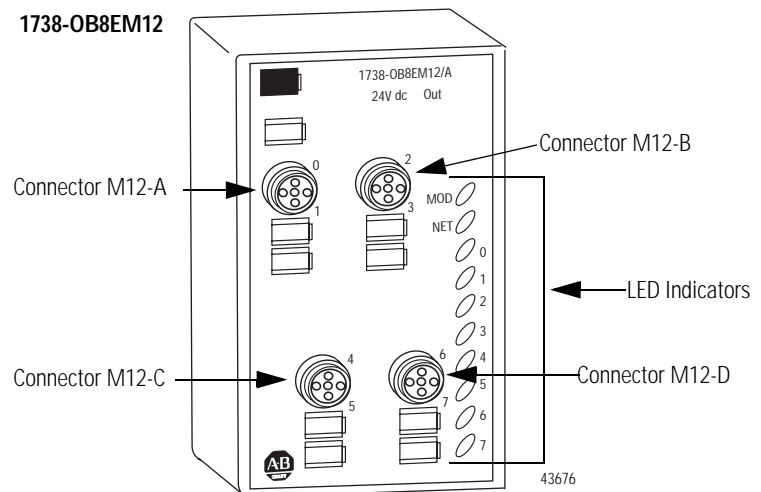

1738-OB8EM8

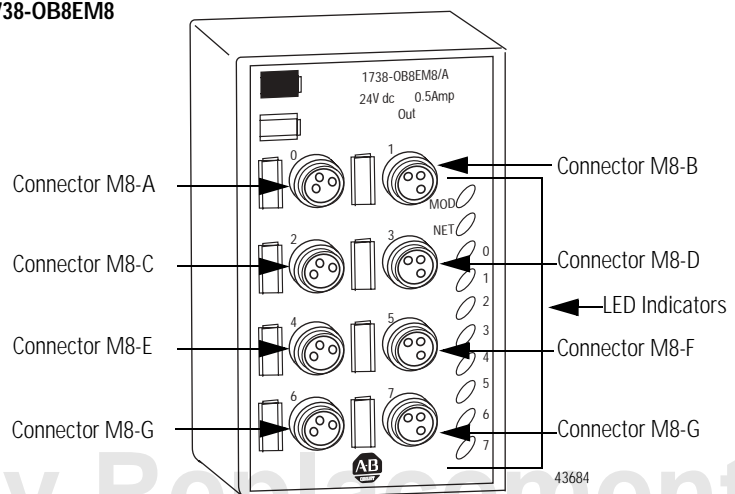

Important User Information

Solid state equipment has operational characteristics differing from those of electromechanical equipment. *Safety Guidelines for the Application, Installation and Maintenance of Solid State Controls* (Publication SGI-1.1 available from your local Rockwell Automation sales office or online at <http://www.ab.com/manuals/gi>) describes some important differences between solid state equipment and hard-wired electromechanical devices. Because of this difference, and also because of the wide variety of uses for solid state equipment, all persons responsible for applying this equipment must satisfy themselves that each intended application of this equipment is acceptable.





In no event will Rockwell Automation, Inc. be responsible or liable for indirect or consequential damages resulting from the use or application of this equipment.

The examples and diagrams in this manual are included solely for illustrative purposes. Because of the many variables and requirements associated with any particular installation, Rockwell Automation, Inc. cannot assume responsibility or liability for actual use based on the examples and diagrams.

No patent liability is assumed by Rockwell Automation, Inc. with respect to use of information, circuits, equipment, or software described in this manual.

Reproduction of the contents of this manual, in whole or in part, without written permission of Rockwell Automation, Inc. is prohibited.

Throughout this manual we use notes to make you aware of safety considerations.

<p>WARNING</p> 	<p>Identifies information about practices or circumstances that can cause an explosion in a hazardous environment, which may lead to personal injury or death, property damage, or economic loss.</p>
<p>IMPORTANT</p>	<p>Identifies information that is critical for successful application and understanding of the product.</p>
<p>ATTENTION</p> 	<p>Identifies information about practices or circumstances that can lead to personal injury or death, property damage, or economic loss. Attentions help you:</p> <ul style="list-style-type: none"> • identify a hazard • avoid a hazard • recognize the consequence
<p>SHOCK HAZARD</p> 	<p>Labels may be located on or inside the equipment to alert people that dangerous voltage may be present.</p>
<p>BURN HAZARD</p> 	<p>Labels may be located on or inside the equipment to alert people that surfaces may be dangerous temperatures.</p>

ATTENTION**Environment and Enclosure**

This equipment is intended for use in overvoltage Category II applications (as defined in IEC publication 60664-1), at altitudes up to 2000 meters without derating.

This equipment is considered Group 1, Class A industrial equipment according to IEC/CISPR Publication 11. Without appropriate precautions, there may be potential difficulties ensuring electromagnetic compatibility in other environments due to conducted as well as radiated disturbance.

This equipment is supplied as "enclosed" equipment. It should not require additional system enclosure when used in locations consistent with the enclosure type ratings stated in the Specifications section of this publication. Subsequent sections of this publication may contain additional information regarding specific enclosure type ratings, beyond what this product provides, that are required to comply with certain product safety certifications.

NOTE: See NEMA Standards publication 250 and IEC publication 60529, as applicable, for explanations of the degrees of protection provided by different types of enclosure. Also, see the appropriate sections in this publication, as well as the Allen-Bradley publication 1770-4.1 ("Industrial Automation Wiring and Grounding Guidelines"), for additional installation requirements pertaining to this equipment.

ATTENTION



Preventing Electrostatic Discharge

This equipment is sensitive to electrostatic discharge, which can cause internal damage and affect normal operation. Follow these guidelines when you handle this equipment:

- Touch a grounded object to discharge potential static.
- Wear an approved grounding wriststrap.
- Do not touch connectors or pins on component boards.
- Do not touch circuit components inside the equipment.
- If available, use a static-safe workstation.
- When not in use, store the equipment in appropriate static-safe packaging.


Mount the I/O Base

To mount the ArmorPoint I/O base on a wall or panel, use the screw holes provided in the ArmorPoint base.

IMPORTANT


The ArmorPoint I/O module must be mounted on a grounded metal mounting plate or other conductive surface.

A mounting illustration for the ArmorPoint base with an adapter is shown below.

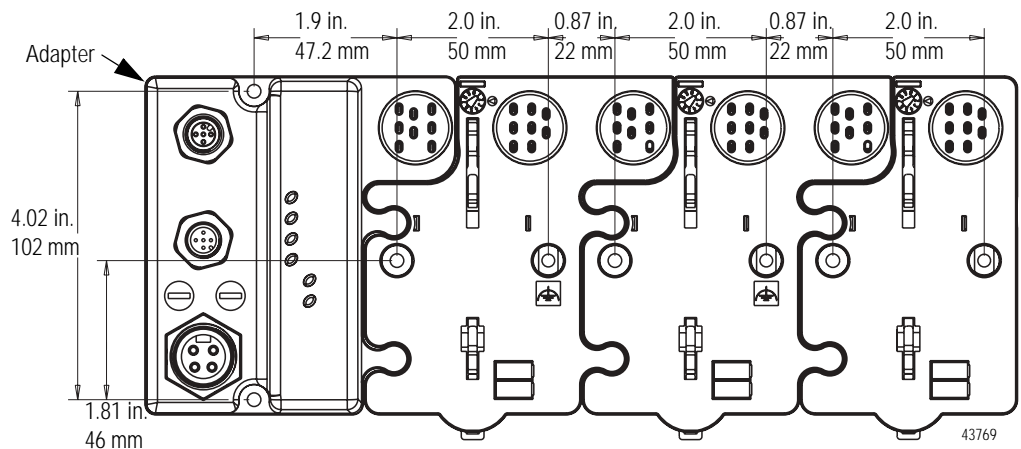

Install the mounting base as follows:


1. Lay out the required points as shown above in the drilling dimension drawing.
2. Drill the necessary holes for #8 (M4) machine or self-tapping screws.
3. Mount the base using #8 (M4) screws.
4. Ground the system using the ground lug connection. (The ground lug connection is also a mounting hole.)

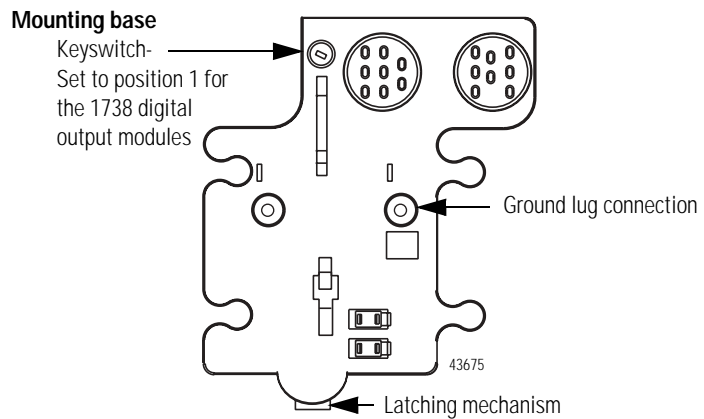

Install the ArmorPoint Digital Output Module

To install the ArmorPoint digital output module, proceed as follows.

1. Using a bladed screwdriver, rotate the keyswitch on the mounting base clockwise until the number 1 aligns with the notch in the base.
2. Position the module vertically above the mounting base. The module will bridge two bases.

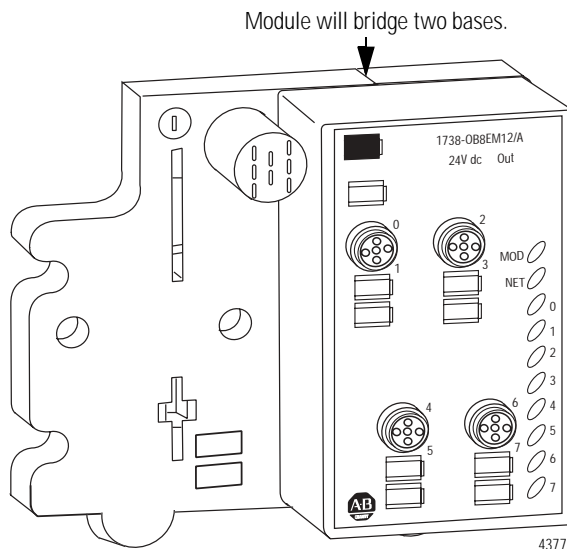

3. Push the module down until it engages the latching mechanism. You will hear a clicking sound when the module is properly engaged.

The locking mechanism will lock the module to the base.

Remove the ArmorPoint Digital Output Module From the Mounting Base

To remove the module from the mounting base:

1. Put a flat blade screwdriver into the slot of the orange latching mechanism.
2. Push the screwdriver toward the I/O module to disengage the latch.


The module will lift up off the base.

3. Pull the module off of the base.

Wire the Output Modules

Following are wiring instructions for the ArmorPoint output modules.

1738-OB2EM12, 1738-OB2EPM12, 1738-OV4EM12, and 1738-OB4EM12



(view into connector)

Pin 1 - 24V dc

Pin 2 - No Connect

Pin 3 - Common

Pin 4 - Output 0 (M12-A)


Output 1 (M12-B)

Output 2 (M12-C) (1738-OV4EM12 and-OB4EM12 only)

Output 3 (M12-D) (1738-OV4EM12 and-OB4EM12 only)

Pin 5 - No Connect

1738-OB4EM8 and 1738-OB8EM8



(view into connector)

Pin 1 - 24V dc

Pin 3 - Common

Pin 4 - Output 0 (M8-A)

Output 1 (M8-B)

Output 2 (M8-C)

Output 3 (M8-D)


Output 4 (M8-E) (1738-OB8EM8 module only)

Output 5 (M8-F) (1738-OB8EM8 module only)

Output 6 (M8-G) (1738-OB8EM8 module only)

Output 7 (M8-H) (1738-OB8EM8 module only)

1738-OB8EM12



(view into connector)

Pin 1 - 24V dc

Pin 2 - Output 1 (M12-A)

Output 3 (M12-B)

Output 5 (M12-C)

Output 7 (M12-D)

Pin 3 - Common

Pin 4 - Output 0 (M12-A)

Output 2 (M12-B)

Output 4 (M12-C)

Output 6 (M12-D)

Pin 5 - No Connect

ATTENTION



Make sure all connectors and caps are securely tightened to properly seal the connections against leaks and maintain IP67 requirements.

Allen-Bradley Replacements

Communicate With Your Module

I/O messages are sent to (consumed) and received from (produced) the ArmorPoint I/O modules. These messages are mapped into the processor's memory. These ArmorPoint I/O output modules produce 1 byte of input data (scanner Rx - status). They consume 1 byte of I/O data (scanner Tx).

Default Data Map for the ArmorPoint Output Modules

1738-OB2EM12 and -OB2EPM12

Message size: 1 Byte

	7	6	5	4	3	2	1	0	
Produces (scanner Rx)	Not Used						Ch1	Ch0	Channel status
Consumes (scanner Tx)	Not Used						Ch1	Ch0	Output state

Where: Channel status 0 = no error, 1 = error; Output state 0 = off, 1 = on

1738-OB4EM12, -OB4EM8, -OV4EM12

Message size: 1 Byte

	7	6	5	4	3	2	1	0	
Produces (scanner Rx)	Not Used				Ch3	Ch2	Ch1	Ch0	Channel status
Consumes (scanner Tx)	Not Used				Ch3	Ch2	Ch1	Ch0	Output state

Where: Channel status 0 = no error, 1 = error; Output state 0 = off, 1 = on

1738-OB8EM12, -OB8EM8


Message size: 1 Byte

	7	6	5	4	3	2	1	0	
Produces (scanner Rx)	Ch7	Ch6	Ch5	Ch4	Ch3	Ch2	Ch1	Ch0	Channel status
Consumes (scanner Tx)	Ch7	Ch6	Ch5	Ch4	Ch3	Ch2	Ch1	Ch0	Output state

Where: Channel status 0 = no error, 1 = error; Output state 0 = off, 1 = on

Troubleshoot with the Indicators

1738-OB8EM12

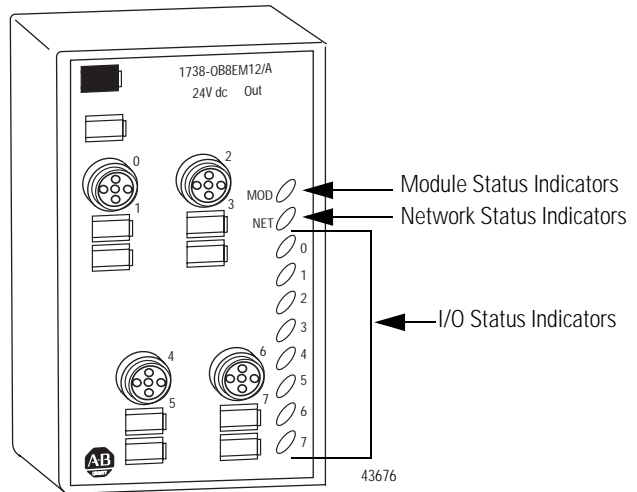

Indication	Probable Cause
Module Status	
Off	No power applied to device
Green	Device operating normally
Flashing Green	Device needs commissioning due to missing, incomplete, or incorrect configuration
Flashing Red	Recoverable fault
Red	Unrecoverable fault - may require device replacement
Flashing Red/Green	Device is in self-test

Indication	Probable Cause
Network Status	
Off	Device is not on line: - Device has not completed dup_MAC-id test. - Device not powered - check module status indicator.
Flashing Green	Device is on line but has no connections in the established state.
Green	Device is on line and has connections in the established state.
Flashing Red	One or more I/O connections in timed-out state.
Red	Critical link failure - failed communication device. Device detected error that prevents it from communicating on the network.
Flashing Red/Green	Communication faulted device - the device has detected a network access error and is in communication faulted state. Device has received and accepted an Identity Communication Faulted Request - long protocol message.

Indication	Probable Cause
I/O Status	
Off	Output is inactive
Yellow	Output is active and under control
Flashing Red	Open circuit detection. No load. (Off-State only)
Red	Short circuit detected. (On-State only)

Specifications

Following are specifications for the 1738 ArmorPoint digital output modules.

ArmorPoint Digital Output Modules	
Outputs per Module	1738-OB2E - 2 (1 group of 2) nonisolated, sourcing 1738-OB2EP - 2 (1 group of 2) nonisolated, sourcing 1738-OB4E - 4 (1 group of 4) nonisolated, sourcing 1738-OV4E - 4 (1 group of 4) nonisolated, sinking 1738-OB8E - 8 (1 group of 8) nonisolated, sourcing
Voltage Drop, On-State Output, Maximum	0.2V dc (sourcing modules) 0.7V dc (sinking module)
Voltage, Off-State Output, Maximum	28.8V dc
Voltage, On-State Output, Maximum	28.8V dc
Minimum	10V dc
Nominal	24V dc
Output Current Rating	1738-OB2E - 1.0 A per channel, not to exceed 2.0 A maximum per module 1738-OB2EP - 2.0 A per channel, 4.0 A maximum per module 1738-OB4E and -OB8E - 1.0 A per channel, not to exceed 3.0 A maximum per module 1738-OV4E - 1.0 A per channel, not to exceed 4.0 A maximum per module
Output Surge Current, Maximum	2 A for 10 ms, repeatable every 3 seconds 1738-OB2EP - 2 A, electronically protected
Current Leakage, Off-State Output, Maximum	0.5 mA
Current, On-State Output Minimum	1.0 mA per channel
Output Delay Time OFF to ON, Maximum ¹	0.1 ms
Output Delay Time, ON to OFF, Maximum ¹	0.1 ms
Output Point Density	2, 4, 8
External DC Power Supply Current	8 mA (2 connector module) 16 mA (4 connector modules) 32 mA (8 connector modules)
External DC Power Supply Voltage Range	10-28.8V dc
External DC Power Supply Voltage Nominal	24V dc
Keyswitch Position	1
General Specifications	
LED Indicators	2, 4, or 8 yellow/red output status, logic side 1 green/red network status, logic side 1 green/red module status, logic side
PointBus Current, Maximum	75 mA @ 5V dc

General Specifications (continued)

Power Dissipation, Maximum	1738-OB2E - 0.8W @ 28.8V dc 1738-OB4E - 1.2W @ 28.8V dc 1738-OB8E - 2.0W @ 28.8V dc 1738-OB2EP - 3.4W @ 28.8V dc 1738-OV4E - 2.9W @ 28.8V dc
Thermal Dissipation, Maximum	1738-OB2E - 2.7 BTU/hr. @ 28.8V dc 1738-OB4E - 4.1 BTU/hr. @ 28.8V dc 1738-OB8E - 6.8 BTU/hr. @ 28.8V dc 1738-OB2EP - 11.6 BTU/hr. @ 28.8V dc 1738-OV4E - 9.9 BTU/hr. @ 28.8V dc
Isolation Voltage (continuous-voltage withstand rating)	50V rms Tested at 1250V ac rms for 60s
Dimensions Inches (Millimeters)	1.25H x 2.63W x 4.25D (31.75H x 66.80W x 107.95D)
Operating Temperature	IEC 60068-2-1 (Test Ad, Operating Cold), IEC 60068-2-2 (Test Bd, Operating Dry Heat), IEC 60068-2-14 (Test Nb, Operating Thermal Shock): -20 to 60°C (-4 to 140°F)
Storage Temperature	IEC 60068-2-1 (Test Ab, Un-packaged Non-operating Cold), IEC 60068-2-2 (Test Bb, Un-packaged Non-operating Dry Heat), -40 to 85°C (-40 to 185°F)
Relative Humidity	IEC 60068-2-30 (Test Db, Un-packaged Non-operating Damp Heat): 5-95% non-condensing
Shock	IEC60068-2-27 (Test Ea, Unpackaged Shock): Operating 30g Non-operating 50g
Vibration	IEC60068-2-6 (Test Fc, Operating): 5g @ 10-500Hz
ESD Immunity	IEC 61000-4-2: 6kV contact discharges 8kV air discharges
Radiated RF Immunity	IEC 61000-4-3: 10V/m with 1kHz sine-wave 80%AM from 30MHz to 2000MHz 10V/m with 200Hz 50% Pulse 100%AM at 900Mhz 10V/m with 200Hz 50% Pulse 100%AM at 1890Mhz
EFT/B Immunity	IEC 61000-4-4: ±3kV at 5kHz on signal ports
Surge Transient Immunity	IEC 61000-4-5: ±1kV line-line(DM) and ±2kV line-earth(CM) on signal ports
Conducted RF Immunity	IEC 61000-4-6: 10Vrms with 1kHz sine-wave 80%AM from 150kHz to 80MHz
Emissions	CSPR 11: Group 1, Class A
Enclosure Type Rating	Meets IP65/66/67 (when marked)
Mounting Base Screw Torque	#8 screw, 7.5 in. lbs. in Aluminum, 16 in. lbs. in Steel
Wiring Category ²	1 - on signal ports
Weigh Imperial (Metric)	0.637 lb. (0.289 kg)

Allen-Bradley Replacements

General Specifications (continued)

Certifications: (when product is marked)	c-UL-us UL Listed Industrial Control Equipment, certified for US and Canada CE ³ European Union 89/336/EEC EMC Directive, compliant with: EN 61000-6-4; Industrial Emissions EN 50082-2; Industrial Immunity EN 61326; Meas./Control/Lab., Industrial Requirements EN 61000-6-2; Industrial Immunity C-Tick ³ Australian Radiocommunications Act, compliant with: AS/NZS CISPR 11; Industrial Emissions
---	--

1. OFF to ON or ON to OFF delay is time from a valid output "on" or "off" signal to output energization or de-energization.
2. Use this Conductor Category information for planning conductor routing. Refer to Publication 1770-4.1, "Industrial Automation Wiring and Grounding Guidelines".
3. See the Product Certification link at www.ab.com for Declarations of Conformity, Certificates, and other certification details.

Notes:

Allen-Bradley Replacements

Rockwell Automation Support

Rockwell Automation provides technical information on the web to assist you in using our products. At <http://support.rockwellautomation.com>, you can find technical manuals, a knowledge base of FAQs, technical and application notes, sample code and links to software service packs, and a MySupport feature that you can customize to make the best use of these tools.

For an additional level of technical phone support for installation, configuration and troubleshooting, we offer TechConnect Support programs. For more information, contact your local distributor or Rockwell Automation representative, or visit <http://support.rockwellautomation.com>.

Installation Assistance

If you experience a problem with a hardware module within the first 24 hours of installation, please review the information that's contained in this manual. You can also contact a special Customer Support number for initial help in getting your module up and running:

United States	1.440.646.3223 Monday – Friday, 8am – 5pm EST
Outside United States	Please contact your local Rockwell Automation representative for any technical support issues.

New Product Satisfaction Return

Rockwell tests all of our products to ensure that they are fully operational when shipped from the manufacturing facility. However, if your product is not functioning and needs to be returned:

United States	Contact your distributor. You must provide a Customer Support case number (see phone number above to obtain one) to your distributor in order to complete the return process.
---------------	---

ArmorPoint is a trademark of Rockwell Automation.

www.rockwellautomation.com

Corporate Headquarters

Rockwell Automation, 777 East Wisconsin Avenue, Suite 1400, Milwaukee, WI, 53202-5302 USA, Tel: (1) 414.212.5200, Fax: (1) 414.212.5201

Headquarters for Allen-Bradley Products, Rockwell Software Products and Global Manufacturing Solutions

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444

Europe: Rockwell Automation SA/NV, Vorstlaan/Boulevard du Souverain 36-BP 3A/B, 1170 Brussels, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640

Asia Pacific: Rockwell Automation, 27/F Citicorp Centre, 18 Whitfield Road, Causeway Bay, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

Headquarters for Dodge and Reliance Electric Products

Americas: Rockwell Automation, 6040 Ponders Court, Greenville, SC 29615-4617 USA, Tel: (1) 864.297.4800, Fax: (1) 864.281.2433

Europe: Rockwell Automation, Brühlstraße 22, D-74834 Elztal-Dallau, Germany, Tel: (49) 6261 9410, Fax: (49) 6261 17741

Asia Pacific: Rockwell Automation, 55 Newton Road, #11-01/02 Revenue House, Singapore 307987, Tel: (65) 351 6723, Fax: (65) 355 1733