



Injection Control Module User's Manual

(Cat. No. 1771-QD/B)

Using This Update

Use this Documentation Update with:

- Injection Control Module User's Manual
(publication 1771-6.5.49) dated June 1990
- Injection Control Module User's Manual Documentation Update
(publication 1771-6.5.49-DU2)

This document:

- corrects errors in the previous update 1771-6.5.49-DU2 (page 1)
- clarifies the definition and application of:
 - IB31, Minimum Percent Shot Size for Pressure Transition (page 2)
 - Profile Ramp Rates (page 2)
- describes enhancements for Revision C of the 1771-QD/B module (page 4)

Keep this document with your manual.

Correct Errors in DU2 for Appendices A and C

Disregard the corrections to pages A-1 and C-6 in documentation update 1771-6.5.49-DU2. The original manual was correct for these pages.

(Page A-1) The following original ranges and units are correct:

- [7] 0-9999 %-travel per second
- [8] 0-9999 %-open per second
- [9] 0-9999 %-close per second

One or more of these changes also appear on pages A-3, A-5, A-6, and A-9.

(Page C-6) The following original ranges and units are correct:

Integer Range 0 to 09999 (9999% = full stroke in 10ms)
BCD Range 0 to 9999
Units Percent travel per second

This change also appears on pages C-6, C-22, C-24, C-32, C-39, C-40, C-52.


**Clarification of IB31,
 Minimum % Shot Size
 for Pressure Transition**

**Chapter 2 (page 2-8) and
 Appendix C (page C-21)**

Change text to the following:

IB31 Minimum Percent Shot Size for Pressure Transition

To guard against premature pressure transitions from pressure spikes, you can program the QD module to allow a ram or cavity pressure transition only after the ram (screw) injects a percentage of the shot size. Starting near the back point, the ram (screw) is inhibited from a pressure transition as it moves right to left until it reaches a percent shot size that you select. For example:

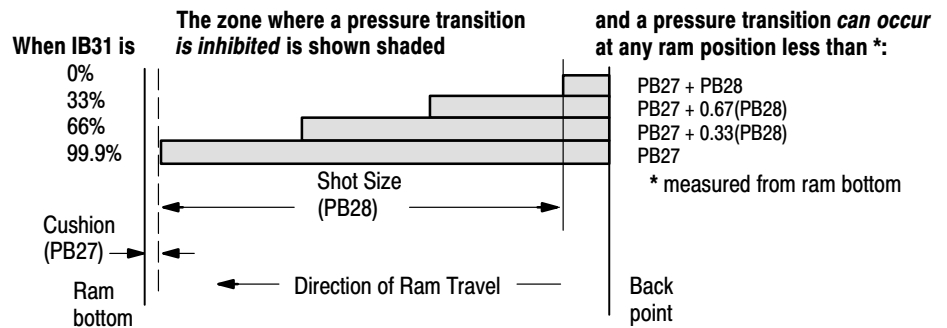

Ranges and units are:

- Integer Range 0 to 099.99
- BCD Range 0 to 99.99
- Units Percent shot size traversed

**Clarification of Profile
 Ramp Rates**

**Appendix C
 (pages C-6, -22, -24, -32, -40, -52)**

Add the following to word descriptions CB10, IB32,33,41,42, PkB17,18, HB21,22, and PB35,36;

We define the range of ramp rate as 0 to 9999% per second, where 9999% = full stroke in 10ms.

For example, ramping 100% of output in 1/4 second equals 400% per second. You would enter typical ramp rates as follows:

For this ramp rate	Enter this value
100% in 10ms	9999
100% in 100ms	1000
100% in 250ms	400

Use this procedure to compute ramp rates:

1. Convert pressure setpoints to percent of maximum pressure. (Velocity setpoints already are in units of percent.)
2. Subtract the setpoints (in percent) to obtain the step change (in percent) over which you want to ramp.
3. Determine how fast (in what part of a second) you want the ramp to occur.
4. Divide the time into the step change from step 2 to compute the ramp rate.

Example:

Compute the acceleration ramp rate required to change from 600 to 1800 PSI in 1/5 second for a system with 2400 PSI maximum pressure.

1. Convert pressure setpoints to percent of maximum pressure.

$$600 \text{ PSI} \div 2400 \text{ PSI} = 25\% \quad 1800 \text{ PSI} \div 2400 \text{ PSI} = 75\%$$

2. Subtract setpoints to obtain ramp range in percent.

$$75\% - 25\% = 50\%$$

3. Ramp time is 1/5 second, defined in the example problem.
4. Divide ramp time into the step change to compute the ramp rate.

$$50\% \text{ step change} \div 1/5 \text{ second ramp time} = 50\% \times 5 = 250\% \text{ per second}$$

Answer = 250% per second

**Enhancements for
 Firmware Revision C**

Chapter 10
 (page 10-1)

Add to the table at the bottom of page 10-1:

If this LED	is this color	Then the QD module sees this condition	We recommend this corrective action
ACTIVE mode.	green	Lost communication with the processor.	1. Verify the processor is in run
FAULT	off	The QD module received a valid config block, but has not received a block transfer from the PLC processor in the time-out period.	2. Check for a processor fault.
AUTO	flashing		3. Troubleshoot your ladder logic.

**Enhancements for
Firmware Revision C
(continued)**

Appendix A

(page A-3)

Replace
CB36-40 RFU

with the following:

CB36-63 RFU
CB64 Reserved for module – Do not use.

(page A-13)

Replace
IS42-50 RFU

with the following:

IS42 Maximum Cavity Pressure in Injection Phase
IS43-50 RFU

(page A-14)

Replace
PkS15-20 RFU

with the following:

PkS15 Maximum Cavity Pressure in Pack Phase
PkS16-20 RFU

Replace
HS17-20 RFU

with the following:

HS17 Maximum Cavity Pressure in Hold Phase
HS18-20 RFU

**Enhancements for
 Firmware Revision C
 (continued)**

**Appendix C
 (page C-12)**

Replace
 CB36 thru
 CB40 Reserved Not monitored by the QD module

with the following:

CB36 thru
 CB63 Reserved Not monitored by the QD module
 CB64 Reserved Reserved for module – Do not use

(page C-88)

Replace
 IS42 thru
 IS50 Reserved Zero when returned by the QD module

with the following

IS42 Max Cavity Pressure
 During Injection Returns the highest cavity pressure
 recorded during the injection phase.

Integer Range 0 to 20000 PSI CB05-B16(14)=0
 0 to 2000.0 Bar CB05-B16(14)=1
 BCD Range 0 to 9999 PSI* CB05-B16(14)=0
 0 to 999.9 Bar* CB05-B16(14)=1

* Double this value when CB05-B17(15)=1

IS43 thru
 IS50 Reserved Zero when returned by the QD module

(page C-91)

Replace
 PkS15 thru
 PkS20 Reserved Zero when returned by the QD module

with the following

PkS15 Max Cavity Pressure
 During Pack Returns the highest cavity pressure
 recorded during the pack phase.

Integer Range 0 to 20000 PSI CB05-B16(14)=0
 0 to 2000.0 Bar CB05-B16(14)=1
 BCD Range 0 to 9999 PSI* CB05-B16(14)=0
 0 to 999.9 Bar* CB05-B16(14)=1

* Double this value when CB05-B17(15)=1

PkS16 thru
 PkS20 Reserved Zero when returned by the QD module

Injection Control Module
 (Cat. No. 1771-QD/B)
 Documentation Update

**Enhancements for
 Firmware Revision C
 (continued)**

(page C-94)

Replace
 HS17 thru
 HS20 Reserved

Zero when returned by the QD module

with the following

HS17 Max Cavity Pressure
 During Hold

Returns the highest cavity pressure
 recorded during the hold phase.

Integer Range 0 to 20000 PSI CB05-B16(14)=0
 0 to 2000.0 Bar CB05-B16(14)=1
 BCD Range 0 to 9999 PSI* CB05-B16(14)=0
 0 to 999.9 Bar* CB05-B16(14)=1

* Double this value when CB05-B17(15)=1

HS18 thru
 HS20 Reserved

Zero when returned by the QD module



ALLEN-BRADLEY
 A ROCKWELL INTERNATIONAL COMPANY

As a subsidiary of Rockwell International, one of the world's largest technology companies — Allen-Bradley meets today's challenges of industrial automation with over 85 years of practical plant-floor experience. More than 13,000 employees throughout the world design, manufacture and apply a wide range of control and automation products and supporting services to help our customers continuously improve quality, productivity and time to market. These products and services not only control individual machines but integrate the manufacturing process, while providing access to vital plant floor data that can be used to support decision-making throughout the enterprise.

With offices in major cities worldwide

**WORLD
 HEADQUARTERS**
 Allen-Bradley
 1201 South Second Street
 Milwaukee, WI 53204 USA
 Tel: (414) 382-2000
 Telex: 43 11 016
 FAX: (414) 382-4444

**EUROPE/MIDDLE
 EAST/AFRICA
 HEADQUARTERS**
 Allen-Bradley Europa B.V.
 Amsterdamseweg 15
 1422 AC Uithoorn
 The Netherlands
 Tel: (31) 2975/60611
 Telex: (844) 18042
 FAX: (31) 2975/60222

**ASIA/PACIFIC
 HEADQUARTERS**
 Allen-Bradley (Hong Kong)
 Limited
 Room 1006, Block B, Sea
 View Estate
 28 Watson Road
 Hong Kong
 Tel: (852) 887-4788
 Telex: (780) 64347
 FAX: (852) 510-9436

**CANADA
 HEADQUARTERS**
 Allen-Bradley Canada
 Limited
 135 Dundas Street
 Cambridge, Ontario N1R
 5X1
 Canada
 Tel: (519) 623-1810
 FAX: (519) 623-8930

**LATIN AMERICA
 HEADQUARTERS**
 Allen-Bradley
 1201 South Second Street
 Milwaukee, WI 53204 USA
 Tel: (414) 382-2000
 Telex: 43 11 016
 FAX: (414) 382-2400