



PROFIBUS DP CompactBlock LDX I/O


(Cat. Nos. 1790P-T8BV8V, -T8BV8B, -TOW6, TN4C0, -TNOC2, T4R0, -T4T0)

What This Document Describes

The following information applies to the above CompactBlock™ LDX I/O catalog numbers and is supplementary information to the enclosed Installation Instructions:

Connect Power to the Block

Wire the connector as shown below:

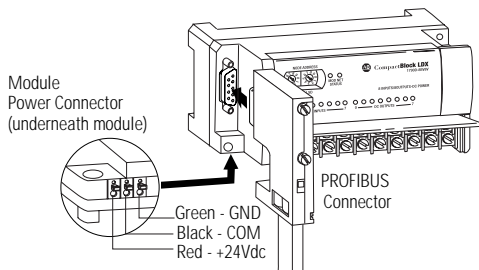

Attach the connector to the base block and use the locking screws on the connector to fasten it to the base block.

Specifications

PROFIBUS DP Specifications

Fail Safe Mode	Supported ¹
----------------	------------------------

¹ Dependent upon the scanner module being used. For example, the SST Scanner (cat. no. SST-PFB-SLC) does not fully support Fail Safe mode as it only resets outputs to 0. You cannot define behavior such as Hold Last State or Fault Value with the SST Scanner.

Allen-Bradley and CompactBlock LDX are trademarks of Rockwell Automation.
PROFIBUS DP is a trademark of PROFIBUS Trade Organization.

www.rockwellautomation.com

Power, Control and Information Solutions Headquarters

Americas: Rockwell Automation, 1201 South Second Street, Milwaukee, WI 53204-2496 USA, Tel: (1) 414.382.2000, Fax: (1) 414.382.4444
Europe/Middle East/Africa: Rockwell Automation, Vorstlaan/Boulevard du Souverain 36, 1170 Brussels, Belgium, Tel: (32) 2 663 0600, Fax: (32) 2 663 0640
Asia Pacific: Rockwell Automation, Level 14, Core F, Cyberport 3, 100 Cyberport Road, Hong Kong, Tel: (852) 2887 4788, Fax: (852) 2508 1846

Publication 1790P-DU001A-EN-P - February 2002

PN 957678-09

Copyright © 2002 Rockwell Automation. All rights reserved. Printed in U.S.A.