




16 Output DC Block I/O Module

Cat. No. 1791-0B16 Series B

Installation

Mount the block I/O module in a vertical (recommended) or horizontal position. Allow sufficient room around the block for cooling air flow through the block module. Refer to Figure 1.

Figure 1
Mounting Dimensions for the Block I/O Module
Cat. No. 1791-0B16 Series B (PLC version shown)

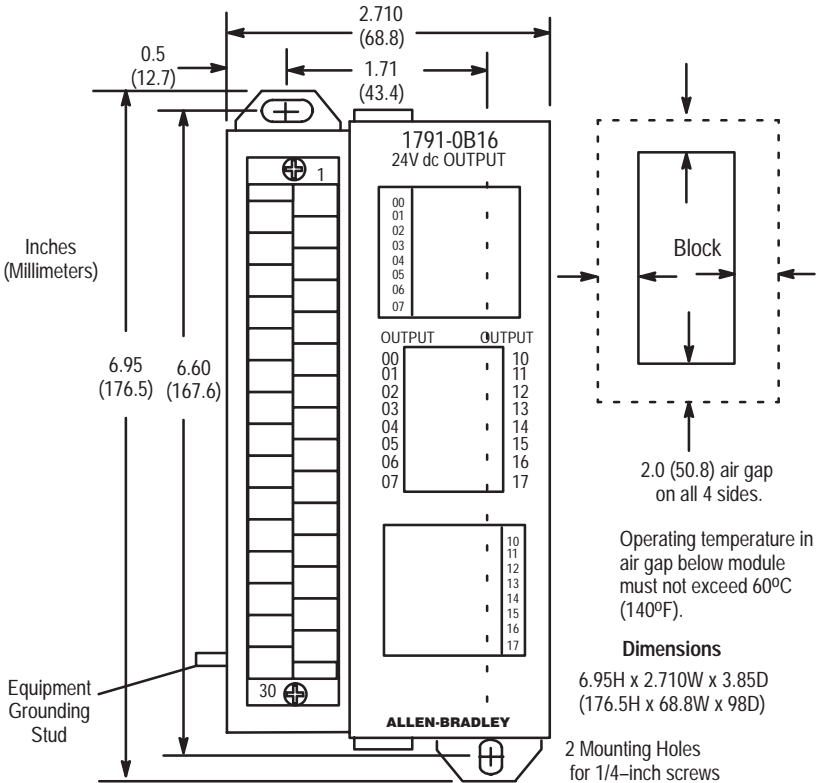

CAUTION: When tightening grounding stud nut, do not exceed 15 in-lbs.

12396-I

Figure 2
Mounting on a DIN Rail


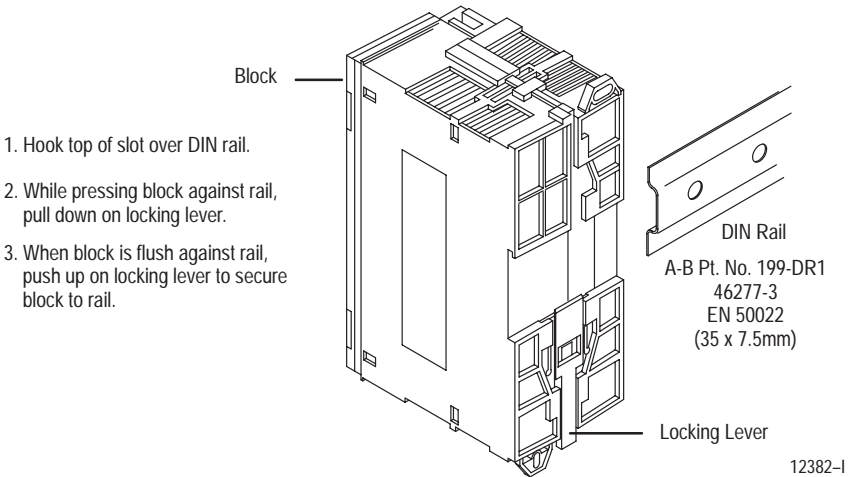


Figure 3
Inserting Labels

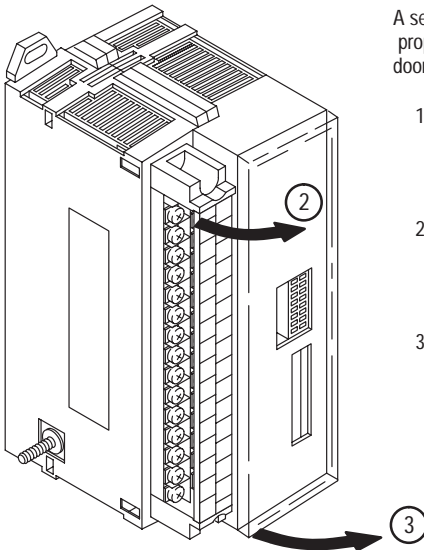


A set of labels is supplied with your module. Select the proper module designation labels (PLC or SLC) for the front door and terminal strip.

1. Remove die-cut labels from package. Select correct labels for your application. (PLC label is numbered 00–07 and 10–17. SLC label is numbered 00–07 and 08–15.)
2. Remove plastic cover on terminal strip by flexing in middle. Slip the terminal designation label into built-in holders in terminal strip cover. Flex cover slightly to install.
3. Open clear front door. Slip module designation label into slots that secure it to the door.

Connect wiring as shown in Figure 4 or Figure 5.


Figure 4
Wiring Connections for the Block I/O Module with PLC Family
Programmable Controllers (refer to Table A)

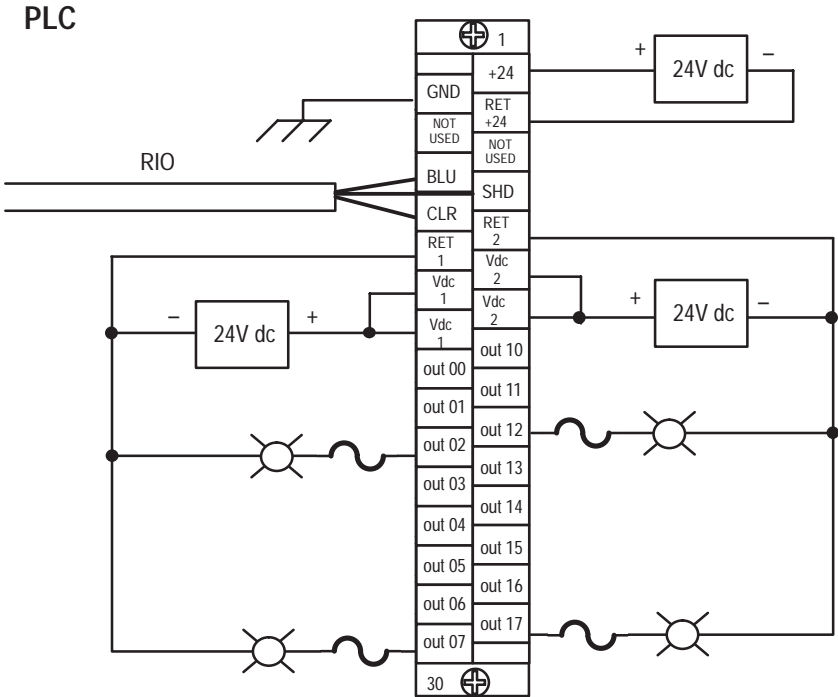

Note: Vdc 1 connections must be externally connected together.
 Vdc 2 connections must be externally connected together.
 Output fusing is recommended. Refer to Table D.

12398-I

Figure 5
Wiring Connections for the Block I/O Module with SLC Family
Controllers (refer to Table A)

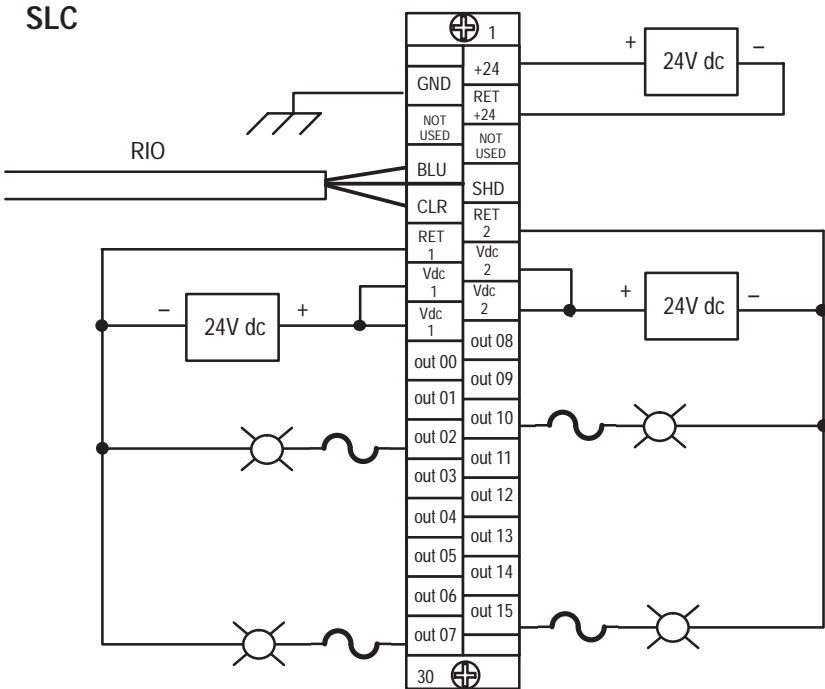

Note: Vdc 1 connections must be externally connected together.
 Vdc 2 connections must be externally connected together.
 Output fusing is recommended. Refer to Table D.

12401-I

The block I/O module has an equipment grounding stud on the lower left side of the module. Connect this grounding stud to your equipment ground. Torque the nut to 15 in-lbs maximum when connecting to your equipment ground.



ATTENTION: Do not overtighten the nut on the grounding stud when connecting the wire. Damage to the module could result.

Refer to “Programmable Controller Wiring and Grounding Guidelines” (1770-4.1) for further information.

Table A
Wiring Block Designations

Connections	1791-0B16 Series B		
	Designation	Description	Terminal No.
Power Connections	+24	+24V dc Power	1
	RET +24	dc Return	3
	GND	Chassis ground	2 ¹
Remote I/O Connections	BLU	Blue wire – RIO	6
	CLR	Clear wire – RIO	8
	SHD	Shield – RIO	7
I/O Connections			
Output	out 00 thru out 07	Output 00 thru 07	16, 18, 20, 22, 24, 26, 28, 30
	Vdc 1	+24V dc output supply	12, 14 ²
	RET 1	dc output return	10
Output	Vdc 2	+24V dc output supply	11, 13 ³
	RET 2	dc output return	9
	PLC: out 10 thru out 17 SLC: out 08 thru out 15	PLC: Output 10 thru 17 SLC: Output 08 thru 15	15, 17, 19, 21, 23, 25, 27, 29
	Not used	For internal test only; not for customer use.	4, 5

¹ Connect chassis ground to equipment grounding stud. These are not internally connected.


² Terminals 12 and 14 must be externally connected by customer to accommodate total amperage.

³ Terminals 11 and 13 must be externally connected by customer to accommodate total amperage.


Table B
Acceptable Wiring Cables for Block I/O Connection

Use	Cable Type
Remote I/O link or Distributed I/O link	Belden 9463
Input and output wiring	Up to 14AWG (2mm ²) stranded with 3/64 inch insulation

Figure 6
Switch Settings

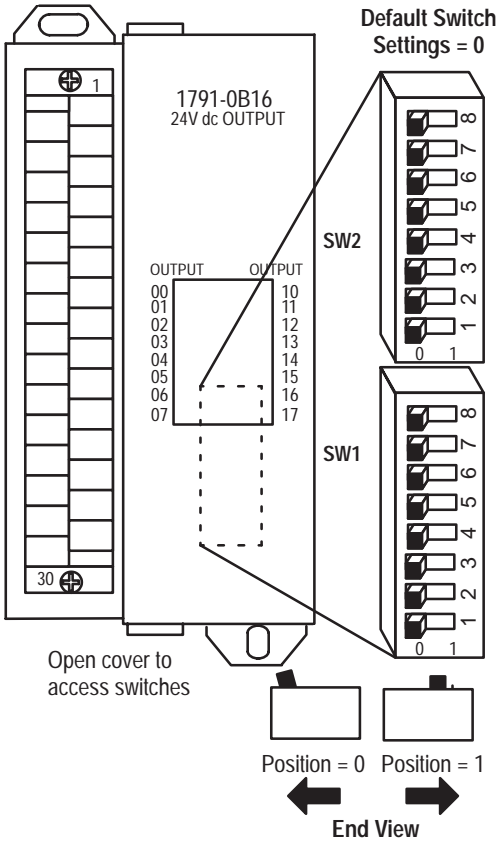

Open cover to access switches



ATTENTION: Cycle power to the module after setting the switches.

Only block I/O modules with all inputs or all outputs can use complementary I/O.

NOTE: Set switch SW2-3 to 0 if this rack will have a unique address (not complemented). If this rack address is a duplicate of another I/O block or chassis, set the switch to 1 for primary or 0 for complementary. Refer to Table C for the complementary I/O rack address.

Series A block I/O modules do not support complementary I/O. If using series A modules, set switch SW2-3 to 0.

SW2-8
Not used

SW2-7
Not used

SW2-6	Last I/O Group
0	Not last rack
1	Last rack

SW2-5	Processor Restart/Lockout (PRL)
0	Processor Restart
1	Processor Lockout

SW2-4	Hold Last State
0	Reset Outputs
1	Hold Last State

SW2-3	Complementary I/O ¹
0	Non-Complemented System
0	Complementary Rack
1	Primary Rack

¹ See Note.

Communication Rate		
SW2-2	SW2-1	Bits/s
0	0	57.6 K
0	1	115.2 K
1	0	230.4 K
1	1	230.4 K

Starting Quarter		
SW1-2	SW1-1	Module Group
0	0	0 (1st)
0	1	2 (2nd)
1	0	4 (3rd)
1	1	6 (4th)

Installation Instructions
Block I/O
Cat. No. 1791-0B16 Series B

1747-SN Rack Number	1771-SN Rack Number	PLC-2 Rack Number	PLC-5 Rack Number	PLC-5/250 Rack Number	PLC-3 Rack Number	SW1 Switch Position					
						8	7	6	5	4	3
Rack 0	Rack 1	Rack 1	Not Valid	Rack 0	Rack 0	0	0	0	0	0	0
Rack 1	Rack 2	Rack 2	Rack 1	Rack 1	Rack 1	0	0	0	0	0	1
Rack 2	Rack 3	Rack 3	Rack 2	Rack 2	Rack 2	0	0	0	0	1	0
Rack 3	Rack 4	Rack 4	Rack 3	Rack 3	Rack 3	0	0	0	0	1	1
	Rack 5	Rack 5	Rack 4	Rack 4	Rack 4	0	0	0	1	0	0
	Rack 6	Rack 6	Rack 5	Rack 5	Rack 5	0	0	0	1	0	1
	Rack 7	Rack 7	Rack 6	Rack 6	Rack 6	0	0	0	1	1	0
	Rack 7	Rack 7	Rack 6	Rack 6	Rack 6	0	0	0	1	1	1
	Rack 10	Rack 10	Rack 7	Rack 7	Rack 7	0	0	1	0	0	0
	Rack 11	Rack 11	Rack 7	Rack 7	Rack 7	0	0	1	0	0	1
	Rack 12	Rack 12	Rack 7	Rack 7	Rack 7	0	0	1	0	1	0
	Rack 13	Rack 13	Rack 7	Rack 7	Rack 7	0	0	1	0	1	1
	Rack 14	Rack 14	Rack 7	Rack 7	Rack 7	0	0	1	1	0	0
	Rack 15	Rack 15	Rack 7	Rack 7	Rack 7	0	0	1	1	0	1
	Rack 16	Rack 16	Rack 7	Rack 7	Rack 7	0	0	1	1	1	0
	Rack 17	Rack 17	Rack 7	Rack 7	Rack 7	0	0	1	1	1	1
	Rack 20	Rack 20	Rack 7	Rack 7	Rack 7	0	1	0	0	0	0
	Rack 21	Rack 21	Rack 7	Rack 7	Rack 7	0	1	0	0	0	1
	Rack 22	Rack 22	Rack 7	Rack 7	Rack 7	0	1	0	0	1	0
	Rack 23	Rack 23	Rack 7	Rack 7	Rack 7	0	1	0	0	1	1
	Rack 24	Rack 24	Rack 7	Rack 7	Rack 7	0	1	0	1	0	0
	Rack 25	Rack 25	Rack 7	Rack 7	Rack 7	0	1	0	1	0	1
	Rack 26	Rack 26	Rack 7	Rack 7	Rack 7	0	1	0	1	1	0
	Rack 27	Rack 27	Rack 7	Rack 7	Rack 7	0	1	0	1	1	1
	Rack 30	Rack 30	Rack 7	Rack 7	Rack 7	0	1	1	0	0	0
	Rack 31	Rack 31	Rack 7	Rack 7	Rack 7	0	1	1	0	0	1
	Rack 32	Rack 32	Rack 7	Rack 7	Rack 7	0	1	1	0	1	0
	Rack 33	Rack 33	Rack 7	Rack 7	Rack 7	0	1	1	0	1	1
	Rack 34	Rack 34	Rack 7	Rack 7	Rack 7	0	1	1	1	0	0
	Rack 35	Rack 35	Rack 7	Rack 7	Rack 7	0	1	1	1	0	1
	Rack 36	Rack 36	Rack 7	Rack 7	Rack 7	0	1	1	1	1	0
Rack 37	Rack 37	Rack 7	Rack 7	Rack 7	0	1	1	1	1	1	
Rack 40	Rack 40	Rack 7	Rack 7	Rack 7	1	0	0	0	0	0	
Rack 41	Rack 41	Rack 7	Rack 7	Rack 7	1	0	0	0	0	1	
Rack 42	Rack 42	Rack 7	Rack 7	Rack 7	1	0	0	0	1	0	
Rack 43	Rack 43	Rack 7	Rack 7	Rack 7	1	0	0	0	1	1	
Rack 44	Rack 44	Rack 7	Rack 7	Rack 7	1	0	0	1	0	0	
Rack 45	Rack 45	Rack 7	Rack 7	Rack 7	1	0	0	1	0	1	
Rack 46	Rack 46	Rack 7	Rack 7	Rack 7	1	0	0	1	1	0	
Rack 47	Rack 47	Rack 7	Rack 7	Rack 7	1	0	0	1	1	1	
Rack 50	Rack 50	Rack 7	Rack 7	Rack 7	1	0	1	0	0	0	

Installation Instructions
 Block I/O
 Cat. No. 1791-0B16 Series B

1747-SN Rack Number	1771-SN Rack Number	PLC-2 Rack Number	PLC-5 Rack Number	PLC-5/250 Rack Number	PLC-3 Rack Number	SW1 Switch Position					
						8	7	6	5	4	3
					Rack 51	1	0	1	0	0	1
					Rack 52	1	0	1	0	1	0
					Rack 53	1	0	1	0	1	1
					Rack 54	1	0	1	1	0	0
					Rack 55	1	0	1	1	0	1
					Rack 56	1	0	1	1	1	0
					Rack 57	1	0	1	1	1	1
					Rack 60	1	1	0	0	0	0
					Rack 61	1	1	0	0	0	1
					Rack 62	1	1	0	0	1	0
					Rack 63	1	1	0	0	1	1
					Rack 64	1	1	0	1	0	0
					Rack 65	1	1	0	1	0	1
					Rack 66	1	1	0	1	1	0
					Rack 67	1	1	0	1	1	1
					Rack 70	1	1	1	0	0	0
					Rack 71	1	1	1	0	0	1
					Rack 72	1	1	1	0	1	0
					Rack 73	1	1	1	0	1	1
					Rack 74	1	1	1	1	0	0
					Rack 75	1	1	1	1	0	1
					Rack 76	1	1	1	1	1	0
					Not Valid	1	1	1	1	1	1

Rack address 77 is an illegal configuration.
 PLC-5/11 processors can scan rack 03.
 PLC-5/15 and PLC-5/20 processors can scan racks 01-03.
 PLC-5/25 and PLC-5/30 processors can scan racks 01-07.
 PLC-5/40 and PLC-5/40L processors can scan racks 01-17.
 PLC-5/60 and PLC-5/60L processors can scan racks 01-27.
 PLC-5/250 processors can scan racks 00-37.

Table C
PLC-2 and PLC-5 With Complementary I/O

PLC-2 Rack Number	PLC-5 Rack Number	SW1 Switch Position					
		8	7	6	5	4	3
Rack 1	Not Valid	0	0	1	0	0	0
Rack 2	Rack 1	0	0	1	0	0	1
Rack 3	Rack 2	0	0	1	0	1	0
Rack 4	Rack 3	0	0	1	0	1	1
Rack 5	Rack 4	0	0	1	1	0	0
Rack 6	Rack 5	0	0	1	1	0	1
Rack 7	Rack 6	0	0	1	1	1	0
	Rack 7	0	0	1	1	1	1

When configured as complementary I/O:
 PLC-2 can scan racks 01-07
 PLC-5/11 can scan rack 03
 PLC-5/20, PLC-5/30, PLC-5/40, PLC-5/60
 can scan racks 01-07

NOTE: Remote rack numbers which can
 have a complementary rack are rack
 numbers 01 thru 07 only.

The SLC 500 controllers communicate with the block I/O using an I/O Scanner module (cat. no. 1747-SN series A). Refer to the user manual for the 1747-SN/A Scanner module for more information.

Note: This block I/O module is **not** compatible with the **1747-DSN** Distributed I/O Scanner module.


Termination Resistor

A termination resistor must be installed on the last block in a series. Connect the resistor as shown in Figure 7.

Figure 7
Installing the Termination Resistor

Connect termination resistor across terminals 6 (BLU) and 8 (CLR).

150 ohm – 57.6K and 115.2K baud
82 ohm – 230.4K baud

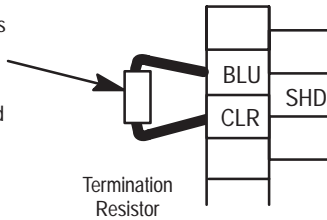


10835-1



ATTENTION: Devices that are operating at 230.4K baud must have 82 ohm terminators in place for proper operation.

Indicators

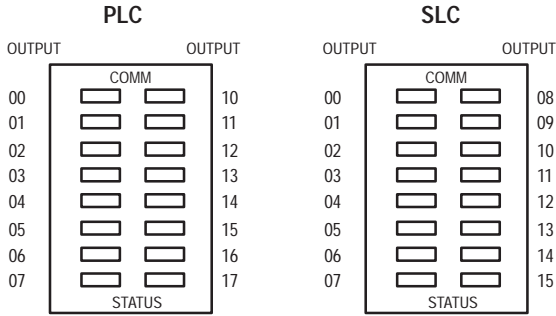

12405-1

Indicator		Description
COMM	OFF	Communication not established
	ON	Communication established
	Flashing	Processor in Program mode
STATUS	OFF	Normal
	ON	Error (hardware or software), block power low
	Flashing	COMM FAIL – communication cable disconnected, 100ms between valid frames, no more than 255 valid frames between valid frames addressed to block, 20ms idle time exceeded.

COMM and STATUS will alternately flash when processor restart lockout is selected, a fault has occurred and the processor is communicating with the block.

Fusing

The block I/O module is internally fused to protect the module. No external power fusing is required.

The outputs of the block I/O modules are not fused. Fusing of outputs is recommended. If desired to fuse an output, you must provide external fusing.

Table D
Recommended Fuses

Type of Circuit	Part Number ¹	Size	Rating in Amps	Maximum Surge Current ² (repeatable every 2s)
dc	Littelfuse 322 1.25	0.25 in. x 1.25 in.	1.25A	2.25A for 50ms
	SAN-O MQ4-800	5mm x 20mm	800mA ³	2.0A for 50ms

¹ Note: Do not substitute another fuse for those listed.

² The recommended fuses will withstand surges of the above listed currents for the time specified.

³ Current must be limited to 650mA when using this fuse.

Block I/O modules are derated linearly above 30°C up to and including 60°C.

Table E
Output Ratings and Non-fused Surge Currents

Catalog Number	Voltage	Mounting	Max. Output Rating:		Maximum Surge Current ¹ (repeatable every 2s)
			@ 30°C	@ 60°C	
1791-0B16/B	24V dc	Vertical	1A	500mA	3A for 50ms
		Horizontal	500mA	250mA	

¹ These surge ratings are for non-fused outputs only.

1791-0B16 Series B Specifications

Output Specifications	
Outputs per Block	16 – 2 groups of 8
Output Voltage Range	10–30V dc
Output Current Rating Vertical Mtg. Horizontal Mtg.	500mA @ 60°C, 1A @ 30°C 250mA @ 60°C, 500mA @ 30°C
Surge Current	3A for 50ms each, repeatable every 2 sec.
Minimum On-state Current	1mA per output
Maximum On-state Voltage Drop	1.0V @ rated current
Off-state Leakage Current (maximum)	0.5mA
Output Signal Delay	0.5ms on; 1.0ms off (maximum)
Specifications continued on next page.	

Installation Instructions

Block I/O

Cat. No. 1791-0B16 Series B

General Specifications

External Power (internally protected - no external fuse required)		
	Voltage	19.2-30V dc
	Current	300mA
Dimensions		Inches 6.95H X 2.7W X 3.85D
	Millimeters	176.5H X 68.8W X 98D
Isolation		Power supply to RIO 500V ac
	I/O Group-to-Group	500V ac
	I/O Group-to-Logic	500V ac
Power Dissipation	Maximum	12.5 Watts
Thermal Dissipation	Maximum	43.0 BTU/hr
Environmental Conditions		
	Operational Temperature	0 to 60°C (32 to 140°F)
	Storage Temperature	-40 to 85°C (-40 to 185°F)
	Relative Humidity	5 to 95% noncondensing
Conductors		Wire Size
		14 gauge (2mm ²) stranded maximum 3/64 inch insulation maximum
	Category	2 ¹

¹ You use this conductor category information for planning conductor routing as described in the system level installation manual.



ALLEN-BRADLEY
A ROCKWELL INTERNATIONAL COMPANY

WORLD HEADQUARTERS
Allen-Bradley
1201 South Second Street
Milwaukee, WI 53204 USA
Tel: (414) 382-2000
Telex: 43 11 016
FAX: (414) 382-4444

With offices in major cities worldwide _____