

中国国家强制性产品认证证书

证书编号: 2009010302353173

委托人名称、地址

罗克韦尔自动化
威斯康星州密尔沃基市南二街1201号

生产者(制造商)名称、地址

罗克韦尔自动化
威斯康星州密尔沃基市南二街1201号

生产企业名称、地址

Rockwell Automation SP Z O O
UL. ROZDZIENSKA 49, 40-382 KATOWICE, POLAND

产品名称和系列、规格、型号

隔离开关

194E-...80..., 194E-...100..., 194E-NX48 参数详见附录

产品标准和技术要求

GB 14048.3-2008


上述产品符合强制性产品认证实施规则
CNCA-01C-011:2007的要求, 特发此证。

发证日期: 2010年04月29日 有效期至: 2015年02月26日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。

本证书为变更证书, 证书首次颁发日期: 2009年07月08日

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询





主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>

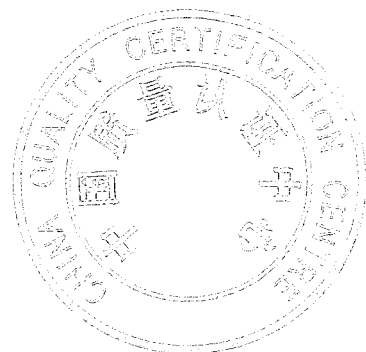



中国国家强制性产品认证证书

附录:

第 1 页 共 6 页

证书编号: 2009010302353173

纸号: 247174

194E-...80...

Ui:690V; Ith:100A;

AC-1,AC-21A:Ue:690V,Ie:80A;

AC-23A:Ue:230V,Ie:72A;Ue:400V,Ie:66A;Ue:690V,Ie:39A;

AC-3:Ue:230V,Ie:61A;Ue:400V,Ie:55A;Ue:690V,Ie:32A;

Icw:2500A; 额定限制短路电流:30kA(400V/415V),20kA(690V);

194E-...100...

Ui:690V; Ith:120A;

AC-1,AC-21A:Ue:690V,Ie:100A;

AC-23A:Ue:230V,Ie:96A;Ue:400V,Ie:97A;Ue:690V,Ie:47A;

AC-3:Ue:230V,Ie:72A;Ue:400V,Ie:66A;Ue:690V,Ie:39A;

Icw:2500A; 额定限制短路电流:15kA;

使用类别:AC-21A、AC-23A、AC-1、AC-3; 极数:3P-8P;

辅助触头:使用类别:AC-15: Ue:AC120V,Ie:6A; Ue:AC240V,Ie:3A; Ue:AC380V,Ie:1.9A;
Ue:AC480V,Ie:1.5A;

Ue:AC500V,Ie:1.4A;Ue:AC600V,Ie:1.2A; 使用类别:DC-13: Ue:DC125V,Ie:0.55A;

Ue:DC250V,Ie:0.27A; Ue:DC400V,Ie:0.15A; Ue:DC500V,Ie:0.13A; Ue:DC600V,Ie:0.1A;

194E-NX48

Ui: 400/415V; Ith: 140A;


AC-21A : Ue: 400/415V; Ie: 120A;

AC-23A : Ue: 230V, 400/415V; Ie: 97A;

Icw: 2500A; 额定限制短路电流:15kA

使用类别: AC-21A、AC-23A 3P

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

中国·北京·南四环西路188号9区100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 2 页 共 6 页

证书编号: 2009010302353173

纸号: 247174

具体的型号标识 (Detail Modal Explanation):

1 Basic switch disconnectors

194E	-	A	80	-	1753
1		2	3		4


1	Product family, Basic Type
2	Installation type: A - Switch disconnector for base/DIN-rail mounting E - Switch disconnector for front/door mounting
3	Load Size: 80 - 80 A 100 - 100 A
4	Function: 1753 - OFF/ON, 3-pole, 2-position 1756 - OFF/ON, 6-pole, 2-position 1783 - OFF/ON, 3-pole, 2-position, inverted 3753 - Changeover, 3-pole, 3-position

2 Handles

194L	-	HE	6	N	-	175
1		2	3	4		5


1	Product family, Basic Type 194L - for 16 A up to 100 A switch disconnectors
2	Installation type:

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

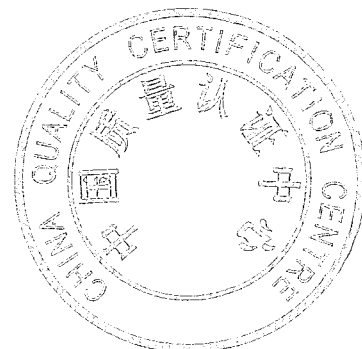

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



中国国家强制性产品认证证书

附录:

第 3 页 共 6 页

证书编号: 2009010302353173

纸号: 247174

	HC - 22.5 mm mounting hole style handle for use with front-mounted switches HE - Screw-mounting handle for use with front- and base-mounted switches
3	Legend plate size: No suffix - no legend plate (mounting hole style handles only) 4 - 48 mm x 48 mm 6 - 63 mm x 63 mm 8 - 88 mm x 88 mm
4	Legend plate type and color A - Square, grey/black I - Square, red/yellow E - Square, lockable, grey/black L - Square, lockable, red/yellow G - Disc, lockable (up to 3 locks), grey/black N - Disc, lockable (up to 3 locks), red/yellow S - Large square with extra legend area B - Mounting hole style handle, with knob lever DC } DD } - Mounting hole style handle, with key, different key removal positions DG }
5	Legend marking 175 - 0 - 1 175I - OFF - ON 350 - 1 - 0 - 2 (Reversing) 375 - 0 - 1 - 2 (90 degrees, changeover) 178 - 0 - 1 178I - OFF - ON 001 - No legend marking (code for mounting hole style handles only)

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 4 页 共 6 页

证书编号: 2009010302353173

纸号: 247174

3 Assembled switch disconnectors (open and enclosed types)

194E	-	Y	80	-	1753-	-	6N
1		2	3		4		5


1	Product family, Basic Type
2	Installation type: A - Base/DIN mounting, open type switch disconnector E - Front/door mounting, open type switch disconnector Y - Enclosed base mounting switch disconnector (uses IP66 ABS thermoplastic enclosure)
3	Load Size: 80 - 80 A 100 - 100 A
4	Configuration: 1753 - 3-pole, OFF/ON 1756 - 6-pole, OFF/ON
5	Handle style: 4A - 194L-HE4A-175 (use with 16 A up to 100 A switch disconnector) 6N - 194L-HE6N-175 (use with 25 A up to 100 A switch disconnector)

4 Auxiliary contact blocks

194E	-	A	-	P11
1		2		3

1	Product family, Basic Type
2	Installation type:

注: 此附录与证书同时使用时有效。





主任:

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

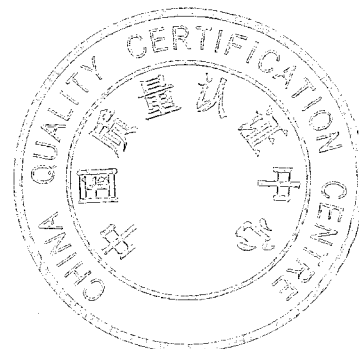



中国国家强制性产品认证证书

附录:

第 5 页 共 6 页

证书编号: 2009010302353173

纸号: 247174

	A - for use with 194E-A...series E - for use with 194E-E...series
3	Contact configuration: P11 - 1 NO + 1 NC PL11 - 1 NO + 1 NC late break P22 - 2 NO + 2 NC PD10 - 1 NO early closing

5 Additional poles

194E	-	A80	-	NP
1		2		3

1	Product family, Basic Type			
2	Installation: A80 - for use with 194E-A80 E80 - for use with 194E-E80 A100 - for use with 194E-A100 E100 - for use with 194E-E100			
3	NP - Code for additional pole			

6 Grounding terminals, Neutral terminals

194E	-	A100	-	PE
1		2		3

1	Product family, Basic Type			
2	Installation: A100 - for use with 194E-A80/A100 E100 - for use with 194E-E80/100			
3	PE - Code for grounding terminal TN - Code for neutral terminal			

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 6 页 共 6 页

证书编号: 2009010302353173


纸号: 247174

7 194E-NX48

194E	-	NX48
1		2

1	194E	Indicates product family
2	NX48	Indicates basic switch disconnecter type 194E-A100-1753 with a padlockable red/yellow handle type 194L-HE4L-175I

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

