



# 中国国家强制性产品认证证书

证书编号: 2009010302353174

## 委托人名称、地址

罗克韦尔自动化  
美国威斯康星州密尔沃基市南二街1201号

## 生产者(制造商)名称、地址

罗克韦尔自动化  
美国威斯康星州密尔沃基市南二街1201号

## 生产企业名称、地址

Rockwell Automation SP Z O O  
UL. ROZDZIENSKA 49, 40-382 KATOWICE, POLAND

## 产品名称和系列、规格、型号

隔离开关

194E-...40..., 194E-...63..., 194E-NX49 参数详见附录

## 产品标准和技术要求

GB 14048.3-2008


上述产品符合强制性产品认证实施规则  
CNCA-01C-011:2007的要求,特发此证。

发证日期: 2010年04月29日      有效期至: 2015年02月26日

证书有效期内本证书的有效性依据发证机构的定期监督获得保持。


本证书为变更证书,证书首次颁发日期: 2009年07月08日

本证书的相关信息可通过国家认监委网站www.cnca.gov.cn查询



主任:

中国质量认证中心

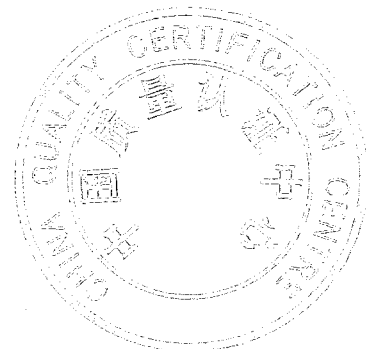


中国·北京·南四环西路188号9区 100070

<http://www.cqc.com.cn>

Allen-Bradley Spares

0247173



# 中国国家强制性产品认证证书

附录:

第 1 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

194E-...40...

Ui: 690V; Ith: 63A;  
AC-1, AC-21A: Ue: 690V, Ie: 40A;  
AC-23A: Ue: 230V, Ie: 51A; Ue: 400V, Ie: 41A; Ue: 690V, Ie: 21A;  
AC-3: Ue: 230V, Ie: 38A; Ue: 400V, Ie: 29A; Ue: 690V, Ie: 17A;  
Icw: 1300A; 额定限制短路电流: 20kA;

194E-...63...

Ui: 690V; Ith: 75A; AC-1, AC-21A: Ue: 690V, Ie: 63A;  
AC-23A: Ue: 230V, Ie: 61A; Ue: 400V, Ie: 55A; Ue: 690V, Ie: 24A;  
AC-3: Ue: 230V, Ie: 51A; Ue: 400V, Ie: 35A; Ue: 690V, Ie: 21A;  
Icw: 1300A; 额定限制短路电流: 15kA (400V/415V), 10kA (690V);  
使用类别: AC-21A、AC-23A、AC-1、AC-3; 极数: 3P-8P;  
辅助触头: 使用类别: AC-15; Ue: AC120V, Ie: 6A; Ue: AC240V, Ie: 3A; Ue: AC380V, Ie: 1.9A;  
Ue: AC480V, Ie: 1.5A;  
Ue: AC500V, Ie: 1.4A; Ue: AC600V, Ie: 1.2A; 使用类别: DC-13; Ue: DC125V, Ie: 0.55A;  
Ue: DC250V, Ie: 0.27A; Ue: DC400V, Ie: 0.15A; Ue: DC500V, Ie: 0.13A; Ue: DC600V, Ie: 0.1A;

194E-NX49

Ui: 400/415V; Ith: 75A;  
AC-21A: Ue: 400/415V; Ie: 63A; AC-23A: Ue: 230V, 400/415V; Ie: 55A; Icw: 1300A;  
额定限制短路电流: 15kA; 使用类别: AC-21A、AC-23A; 3P

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心



中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



# 中国国家强制性产品认证证书

附录:

第 2 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

具体的型号标识 (Detail Modal Explanation):

1 Basic switch disconnectors

194E	-	A	40	-	1753
1		2	3		4


1	Product family, Basic Type
2	Installation type: A - Switch disconnector for base/DIN-rail mounting E - Switch disconnector for front/door mounting
3	Load Size: 40 - 40 A 63 - 63 A
4	Function: 1753 - OFF/ON, 3-pole, 2-position 1756 - OFF/ON, 6-pole, 2-position 1783 - OFF/ON, 3-pole, 2-position, inverted 3753 - Changeover, 3-pole, 3-position

2 Handles

194L	-	HE	6	N	-	175
1		2	3	4		5


1	Product family, Basic Type 194L - for 16 A up to 100 A switch disconnectors
---	--------------------------------------------------------------------------------

注: 此附录与证书同时使用时有效。



主任:


中国质量认证中心

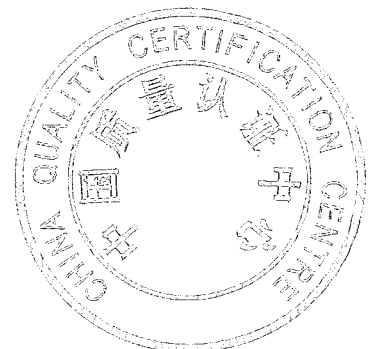

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

Allen-Bradley Spares



# 中国国家强制性产品认证证书

附录:

第 3 页 共 6 页


证书编号: 2009010302353174

纸号: 247173

2	Installation type: HC - 22.5 mm mounting hole style handle for use with front-mounted switches HE - Screw-mounting handle for use with front- and base-mounted switches
3	Legend plate size: No suffix - no legend plate (mounting hole style handles only) 4 - 48 mm x 48 mm 6 - 63 mm x 63 mm 8 - 88 mm x 88 mm
4	Legend plate type and color A - Square, grey/black I - Square, red/yellow E - Square, lockable, grey/black L - Square, lockable, red/yellow G - Disc, lockable (up to 3 locks), grey/black N - Disc, lockable (up to 3 locks), red/yellow S - Large square with extra legend area B - Mounting hole style handle, with knob lever DC } DD } - Mounting hole style handle, with key, different key removal positions DG }
5	Legend marking 175 - 0 - 1 175I - OFF - ON 350 - 1 - 0 - 2 (Reversing) 375 - 0 - 1 - 2 (90 degrees, changeover) 178 - 0 - 1 178I - OFF - ON 001 - No legend marking (code for mounting hole style handles only)

3 Assembled switch disconnectors (open and enclosed types)

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

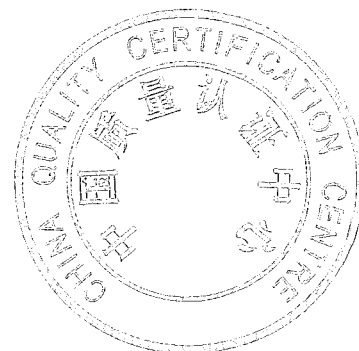



# 中国国家强制性产品认证证书

附录:

第 4 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

194E	-	Y	40	-	1753-	-	6N
1		2	3		4		5

1	Product family, Basic Type
2	Installation type: A - Base/DIN mounting, open type switch disconnecter E - Front/door mounting, open type switch disconnecter Y - Enclosed base mounting switch disconnecter (uses IP66 ABS thermoplastic enclosure)
3	Load Size: 40 - 40 A 63 - 63 A
4	Configuration: 1753 - 3-pole, OFF/ON 1756 - 6-pole, OFF/ON
5	Handle style: 4A - 194L-HE4A-175 6N - 194L-HE6N-175

4 Auxiliary contact blocks


194E	-	A	-	P11
1		2		3

注: 此附录与证书同时使用时有效。



主任:


中国质量认证中心

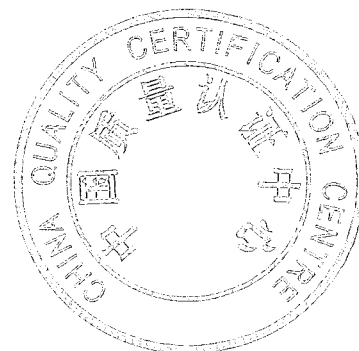

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

Allen-Bradley Spares



# 中国国家强制性产品认证证书

附录:

第 5 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

1	Product family, Basic Type
2	Installation type: A - for use with 194E-A40 up to -A63 E - for use with 194E-E40 up to -E63
3	Contact configuration: P11 - 1 NO + 1 NC PL11 - 1 NO + 1 NC late break P22 - 2 NO + 2 NC PD10 - 1 NO early closing

5 Additional poles

194E	-	A4	-	NP
		0		
1		2		3


1	Product family, Basic Type			
2	Installation: A40 - for use with 194E-A40      E40 - for use with 194E-E40 A63 - for use with 194E-A63      E63 - for use with 194E-E63			
3	NP - Code for additional pole			

6 Grounding terminals, Neutral terminals

194E	-	A6	-	PE
		3		
1		2		3

1	Product family, Basic Type
2	Installation:

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





# 中国国家强制性产品认证证书

附录:

第 6 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

	A63 - for use with 194E-A40/A63	E63 - for use with 194E-E40/E63
3	PE - Code for grounding terminal	TN - Code for neutral terminal

## 7.194E-NX49

194E	-	NX49
1		2


1	194E	Indicates product family
2	NX49	Indicates basic switch disconnecter type 194E-A63-1753 with a padlockable red/yellow handle type 194L-HE4L-1751

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

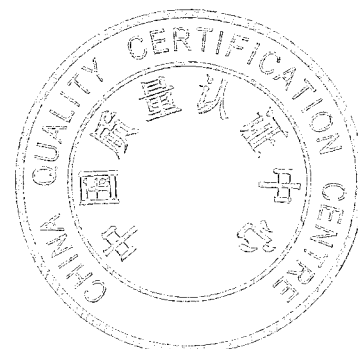

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

Allen-Bradley Spares