



CERTIFICATE FOR CHINA COMPULSORY PRODUCT CERTIFICATION

No. : 2009010302353174

NAME AND ADDRESS OF THE APPLICANT

Rockwell Automation Inc.
1201 South Second Street, Milwaukee WI 53204, USA

NAME AND ADDRESS OF THE MANUFACTURER

Rockwell Automation Inc.
1201 South Second Street, Milwaukee WI 53204, USA

NAME AND ADDRESS OF THE FACTORY

Rockwell Automation SP Z O O
UL. ROZDZIENSKA 49, 40-382 KATOWICE, POLAND

NAME, MODEL AND SPECIFICATION

Switch Disconnectors

194E-...40..., 194E-...63..., 194E-NX49 For detail modal please see the appendix

THE STANDARDS AND TECHNICAL REQUIREMENTS FOR THE PRODUCTS

GB 14048.3-2008

This is to certify that the above mentioned products have met the requirements of implementation rules for compulsory certification(REF NO. CNCA-01C-011:2007).

Date of issue: Apr.29, 2010 Date of expiry: Feb.26, 2015

Validity of this certificate is subject to positive result of the regular follow up inspection by issuing certification body until the expiry date.


Date of original certification: Jul.08, 2009

This certificate can be verified through CNCA's website: www.cnca.gov.cn



President:


Wang Keqiao

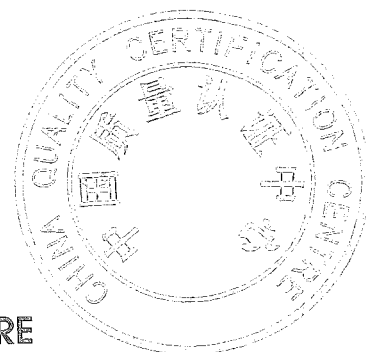


CHINA QUALITY CERTIFICATION CENTRE

Section 9, No.188, Nansihuan Xilu, Beijing 100070 P.R.China
<http://www.cqc.com.cn>

Allen-Bradley Replacements

Q 0247173



中国国家强制性产品认证证书

附录:

第 1 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

194E-...40...

Ui: 690V; Ith: 63A;
AC-1, AC-21A: Ue: 690V, Ie: 40A;
AC-23A: Ue: 230V, Ie: 51A; Ue: 400V, Ie: 41A; Ue: 690V, Ie: 21A;
AC-3: Ue: 230V, Ie: 38A; Ue: 400V, Ie: 29A; Ue: 690V, Ie: 17A;
Icw: 1300A; 额定限制短路电流: 20kA;

194E-...63...

Ui: 690V; Ith: 75A; AC-1, AC-21A: Ue: 690V, Ie: 63A;
AC-23A: Ue: 230V, Ie: 61A; Ue: 400V, Ie: 55A; Ue: 690V, Ie: 24A;
AC-3: Ue: 230V, Ie: 51A; Ue: 400V, Ie: 35A; Ue: 690V, Ie: 21A;
Icw: 1300A; 额定限制短路电流: 15kA (400V/415V), 10kA (690V);
使用类别: AC-21A、AC-23A、AC-1、AC-3; 极数: 3P-8P;
辅助触头: 使用类别: AC-15; Ue: AC120V, Ie: 6A; Ue: AC240V, Ie: 3A; Ue: AC380V, Ie: 1.9A;
Ue: AC480V, Ie: 1.5A;
Ue: AC500V, Ie: 1.4A; Ue: AC600V, Ie: 1.2A; 使用类别: DC-13; Ue: DC125V, Ie: 0.55A;
Ue: DC250V, Ie: 0.27A; Ue: DC400V, Ie: 0.15A; Ue: DC500V, Ie: 0.13A; Ue: DC600V, Ie: 0.1A;

194E-NX49

Ui: 400/415V; Ith: 75A;
AC-21A: Ue: 400/415V; Ie: 63A; AC-23A: Ue: 230V, 400/415V; Ie: 55A; Icw: 1300A;
额定限制短路电流: 15kA; 使用类别: AC-21A、AC-23A; 3P

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 2 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

具体的型号标识 (Detail Modal Explanation):

1 Basic switch disconnectors

194E	-	A	40	-	1753
1		2	3		4


1	Product family, Basic Type
2	Installation type: A - Switch disconnector for base/DIN-rail mounting E - Switch disconnector for front/door mounting
3	Load Size: 40 - 40 A 63 - 63 A
4	Function: 1753 - OFF/ON, 3-pole, 2-position 1756 - OFF/ON, 6-pole, 2-position 1783 - OFF/ON, 3-pole, 2-position, inverted 3753 - Changeover, 3-pole, 3-position

2 Handles

194L	-	HE	6	N	-	175
1		2	3	4		5

1	Product family, Basic Type 194L - for 16 A up to 100 A switch disconnectors
---	--

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心



中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>



中国国家强制性产品认证证书

附录:

第 3 页 共 6 页


证书编号: 2009010302353174

纸号: 247173

2	Installation type: HC - 22.5 mm mounting hole style handle for use with front-mounted switches HE - Screw-mounting handle for use with front- and base-mounted switches
3	Legend plate size: No suffix - no legend plate (mounting hole style handles only) 4 - 48 mm x 48 mm 6 - 63 mm x 63 mm 8 - 88 mm x 88 mm
4	Legend plate type and color A - Square, grey/black I - Square, red/yellow E - Square, lockable, grey/black L - Square, lockable, red/yellow G - Disc, lockable (up to 3 locks), grey/black N - Disc, lockable (up to 3 locks), red/yellow S - Large square with extra legend area B - Mounting hole style handle, with knob lever DC } DD } - Mounting hole style handle, with key, different key removal positions DG }
5	Legend marking 175 - 0 - 1 175I - OFF - ON 350 - 1 - 0 - 2 (Reversing) 375 - 0 - 1 - 2 (90 degrees, changeover) 178 - 0 - 1 178I - OFF - ON 001 - No legend marking (code for mounting hole style handles only)

3 Assembled switch disconnectors (open and enclosed types)

注: 此附录与证书同时使用时有效。




主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

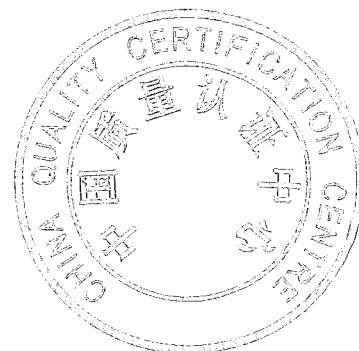



中国国家强制性产品认证证书

附录:

第 4 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

194E	-	Y	40	-	1753-	-	6N
1		2	3		4		5

1	Product family, Basic Type
2	Installation type: A - Base/DIN mounting, open type switch disconnecter E - Front/door mounting, open type switch disconnecter Y - Enclosed base mounting switch disconnecter (uses IP66 ABS thermoplastic enclosure)
3	Load Size: 40 - 40 A 63 - 63 A
4	Configuration: 1753 - 3-pole, OFF/ON 1756 - 6-pole, OFF/ON
5	Handle style: 4A - 194L-HE4A-175 6N - 194L-HE6N-175

4 Auxiliary contact blocks


194E	-	A	-	P11
1		2		3

注: 此附录与证书同时使用时有效。



主任:


中国质量认证中心

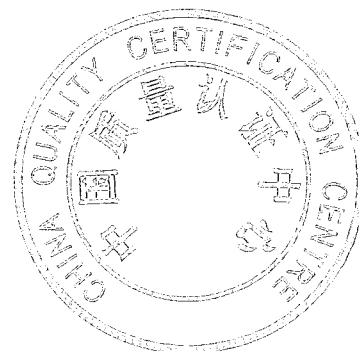

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>

Allen-Bradley Replacements



中国国家强制性产品认证证书

附录:

第 5 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

1	Product family, Basic Type
2	Installation type: A - for use with 194E-A40 up to -A63 E - for use with 194E-E40 up to -E63
3	Contact configuration: P11 - 1 NO + 1 NC PL11 - 1 NO + 1 NC late break P22 - 2 NO + 2 NC PD10 - 1 NO early closing

5 Additional poles

194E	-	A4	-	NP
		0		
1		2		3

1	Product family, Basic Type			
2	Installation: A40 - for use with 194E-A40 E40 - for use with 194E-E40 A63 - for use with 194E-A63 E63 - for use with 194E-E63			
3	NP - Code for additional pole			

6 Grounding terminals, Neutral terminals

194E	-	A6	-	PE
		3		
1		2		3

1	Product family, Basic Type
2	Installation:

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

中国 · 北京 · 南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>





中国国家强制性产品认证证书

附录:

第 6 页 共 6 页

证书编号: 2009010302353174

纸号: 247173

	A63 - for use with 194E-A40/A63	E63 - for use with 194E-E40/E63
3	PE - Code for grounding terminal	TN - Code for neutral terminal

7.194E-NX49

194E	-	NX49
1		2


1	194E	Indicates product family
2	NX49	Indicates basic switch disconnecter type 194E-A63-1753 with a padlockable red/yellow handle type 194L-HE4L-1751

注: 此附录与证书同时使用时有效。



主任:

中国质量认证中心

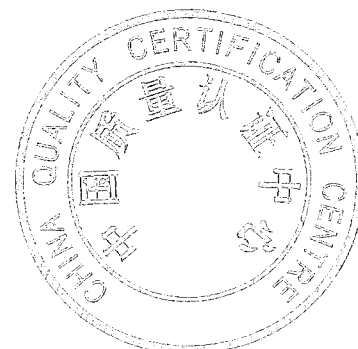

中国·北京·南四环西路 188 号 9 区 100070

<http://www.cqc.com.cn>