



A

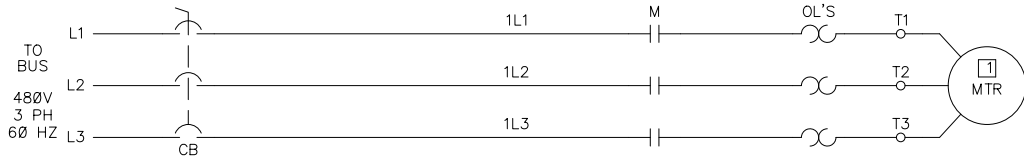


B

C

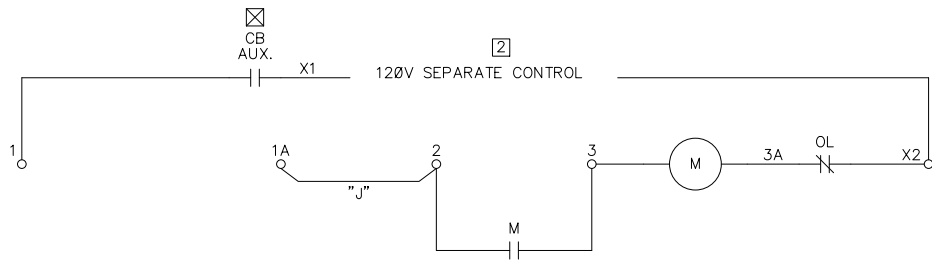

D

E



F

THE CIRCUIT IS TYPICAL OF A SIZE 1 BUL 2113 FVNR STARTER WITH 120 VOLT SEPARATE CONTROL
 OPTIONS:
 - 1 N.O. AUXILIARY CONTACT ON THE CIRCUIT BREAKER

A COMPLETE AND ACCURATE REPRESENTATION OF THE CIRCUIT DEPENDS ON THE SIZE AND OPTIONS ORDERED.

G

NOTES

- ① REMOTE DEVICE
- ② ADDITIONAL CONTROL CIRCUIT OVERCURRENT PROTECTION MAY BE REQUIRED WHEN THE CONTROL CIRCUIT CONDUCTORS EXTEND BEYOND THE ENCLOSURE. REFER TO NATIONAL ELECTRICAL CODE.
- ☒ THIS IS AN EXTERNAL CIRCUIT BREAKER AUXILIARY AND SHOULD NOT BE USED FOR BREAKER TRIP INDICATION.

H

References		Bul 2113 FVNR	
Revision	Release	Dimensions Apply Before Surface Treatment	Dimensions in Inches Tolerances Unless Otherwise Specified
1	06/15/01	2 Place Decimal ± .02	3 Place Decimal ± .005
		Angles ± 1	
Refer. Book		Dr.	Date
		Chkd.	Date
		Appd.	Date



Sheet 1 Of 1
 Dwg Size C
 2113WB003