



A

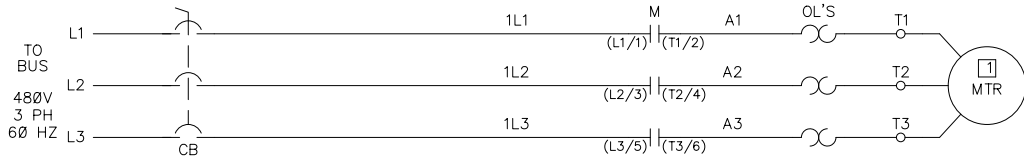


B


C

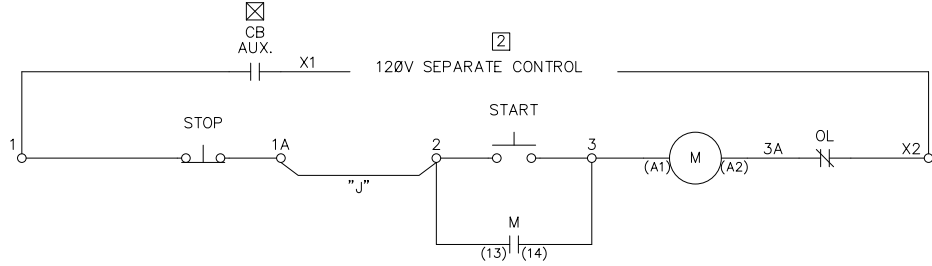

D



E



F

THE CIRCUIT IS TYPICAL OF A 200 AMP BUL 2113 FVNR VACUUM STARTER WITH 120 VOLT SEPARATE CONTROL

- OPTIONS:
- 1 'STOP' PUSH BUTTON
 - 1 'START' PUSH BUTTON
 - 2 N.O. UNWIRED AUXILIARY CONTACTS ON THE STARTER
 - 2 N.C. UNWIRED AUXILIARY CONTACTS ON THE STARTER
 - 1 N.O. AUXILIARY CONTACT ON THE CIRCUIT BREAKER

G

A COMPLETE AND ACCURATE REPRESENTATION OF THE CIRCUIT DEPENDS ON THE RATING AND OPTIONS ORDERED.

H

NOTES

- 1 REMOTE DEVICE
- 2 ADDITIONAL CONTROL CIRCUIT OVERCURRENT PROTECTION MAY BE REQUIRED WHEN THE CONTROL CIRCUIT CONDUCTORS EXTEND BEYOND THE ENCLOSURE. REFER TO NATIONAL ELECTRICAL CODE.
- X THIS IS AN EXTERNAL CIRCUIT BREAKER AUXILIARY AND SHOULD NOT BE USED FOR BREAKER TRIP INDICATION.

References		Bul 2113 FVNR (VACUUM)	
Revision	Release	Dimensions Apply Before Surface Treatment	Dimensions in Inches Unless Otherwise Specified
1	06/15/01	2 Place Decimal ±.02	3 Place Decimal ±.005
		Angles ±1	
Refer. Book		Dr.	Date
		Chkd.	Date
		Appd.	Date



Sheet 1 Of 1
Dwg Size C
2113WB029

Allen-Bradley Parts