


NOTES

A ☒
 THIS IS AN EXTERNAL CIRCUIT
 BREAKER AUXILIARY AND
 SHOULD NOT BE USED FOR
 BREAKER TRIP INDICATION.


B ●
 INTERNAL CB DEVICES
 SUPPLIED WITH UNMOUNTED
 CONNECTION BLOCKS.

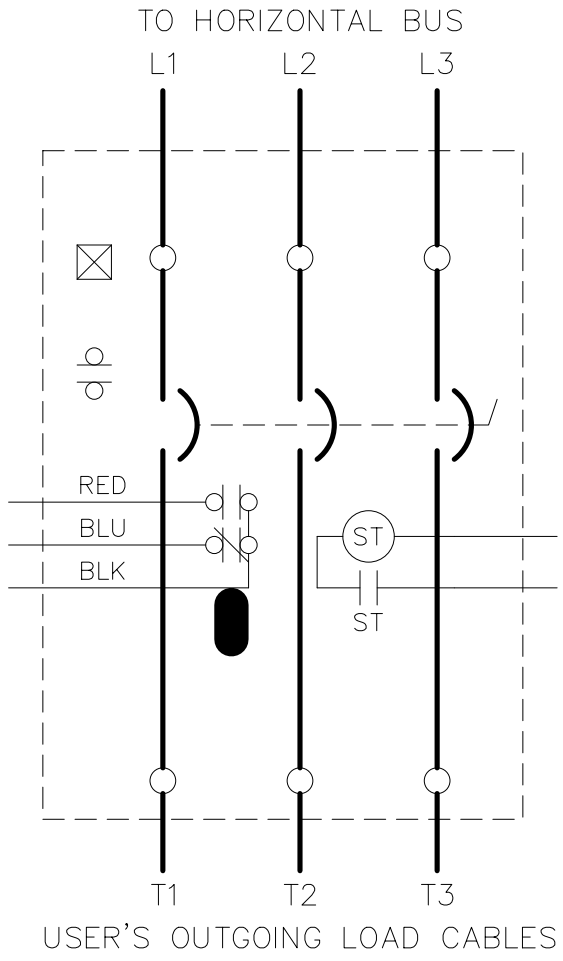

F THE CIRCUIT IS TYPICAL OF A 150A BUL 2193F CIRCUIT BREAKER FEEDER UNIT
 OPTIONS:

- 1 N.O. EXTERNAL AUXILIARY CONTACT ON CIRCUIT BREAKER
- 1 N.O. INTERNAL AUXILIARY CONTACT IN THE CIRCUIT BREAKER
- 1 N.C. INTERNAL AUXILIARY CONTACT IN THE CIRCUIT BREAKER
- A SHUNT TRIP INTERNAL TO THE CIRCUIT BREAKER

G A COMPLETE AND ACCURATE REPRESENTATION OF THE CIRCUIT DEPENDS ON THE
 SIZE AND OPTIONS ORDERED.

References		BUL. 2193F		 Allen-Bradley Rockwell Automation
Revision		150 AMP "F" FRAME		
1	06/23/01	Dimensions Apply Before Surface Treatment Dimensions in Inches Tolerances Unless Otherwise Specified 2 Place Decimal ±.02 3 Place Decimal ±.005 Angles ± 1	Dr. _____ Date _____ Chkd. _____ Date _____ Appd. _____ Date _____	Sheet 1 Of 1 Dwg Size A 2193FWB006