
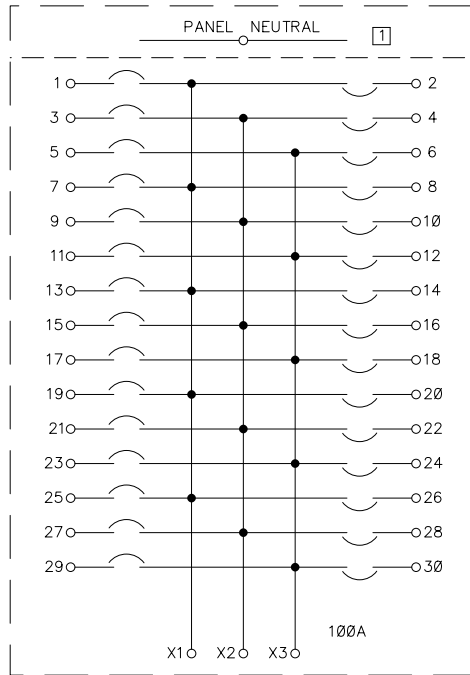


A [1] OTHER SIDE OF EACH CIRCUIT IS ALSO CONNECTED TO PANEL NEUTRAL.

LIGHTING PANEL SUPPLIED WITH:  
 16 - 15A. - 1 POLE BREAKER(S)  
 4 - 30A. - 2 POLE BREAKER(S)  
 2 - 20A. - 3 POLE BREAKER(S)

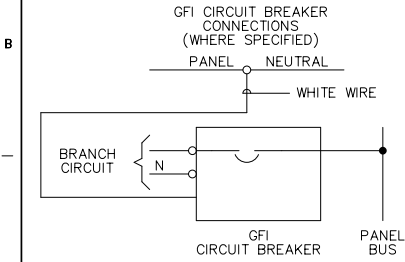

D

E

F

THIS LAYOUT IS TYPICAL OF A BUL 2193LE THREE PHASE, 4 WIRE, LIGHTING PANEL WITH 100A MAIN LUG.  
 ACTUAL LOCATION OF BRANCH BREAKERS IS DETERMINED BY MANUFACTURING.

- IT CONTAINS:
- 16 1-POLE 15A BRANCH BREAKERS
  - 4 2-POLE 30A BRANCH BREAKERS
  - 2 3-POLE 20A BRANCH BREAKERS

H

References		BUL. 2193LE 3-PHASE		
Revision		LIGHTING PANEL		
1	08/28/01	Release	Dimensions Apply Before Surface Treatment	Sheet 1 Of 1 Dwg Size C 2193LEWB003
			Dimensions in Inches Tolerances Unless Otherwise Specified	
			2 Place Decimal ± .02	
			3 Place Decimal ± .005	
Refer. Book			Angles ± 1	Dr. _____ Date _____ Chkd. _____ Date _____ Appd. _____ Date _____