



A [1] OTHER SIDE OF EACH CIRCUIT IS ALSO CONNECTED TO PANEL NEUTRAL.

LIGHTING PANEL SUPPLIED WITH:  
 2 - 15A. - 1 POLE BREAKER(S)  
 14 - 20A. - 2 POLE BREAKER(S)

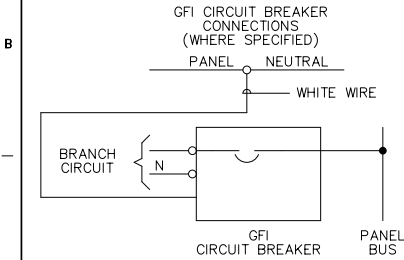

C REFER TO MANUFACTURERS INSTRUCTIONS FOR INSTALLATION AND TESTING.

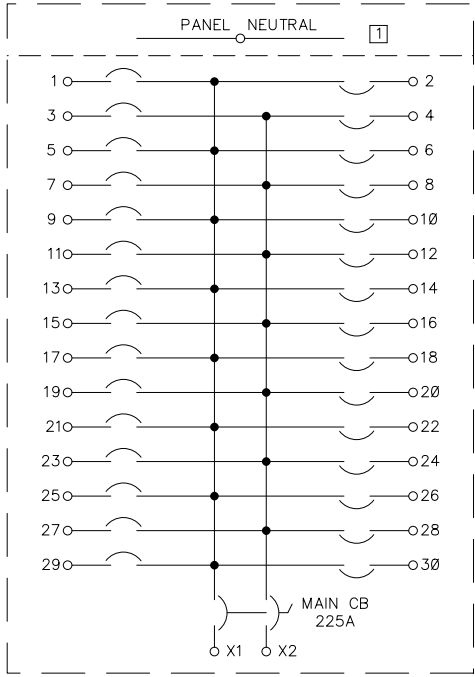

G THIS LAYOUT IS TYPICAL OF A BUL 2193LE SINGLE PHASE, 3 WIRE, LIGHTING PANEL WITH 225A MAIN CIRCUIT BREAKER. ACTUAL LOCATION OF BRANCH BREAKERS IS DETERMINED BY MANUFACTURING.

- IT CONTAINS:
- 2 1-POLE 15A BRANCH BREAKERS
  - 14 2-POLE 20A BRANCH BREAKERS

References		BUL. 2193LE SINGLE PHASE		
Revision		LIGHTING PANEL		
1	08/28/01	Release	Dimensions Apply Before Surface Treatment	Dr. _____ Date _____
			Dimensions in Inches Tolerances Unless Otherwise Specified	Chkd. _____ Date _____
			2 Place Decimal ± .02	Appd. _____ Date _____
			3 Place Decimal ± .005	
			Angles ± 1	
Refer. Book				Sheet 1 Of 1
				Dwg Size C 2193LEWB006