
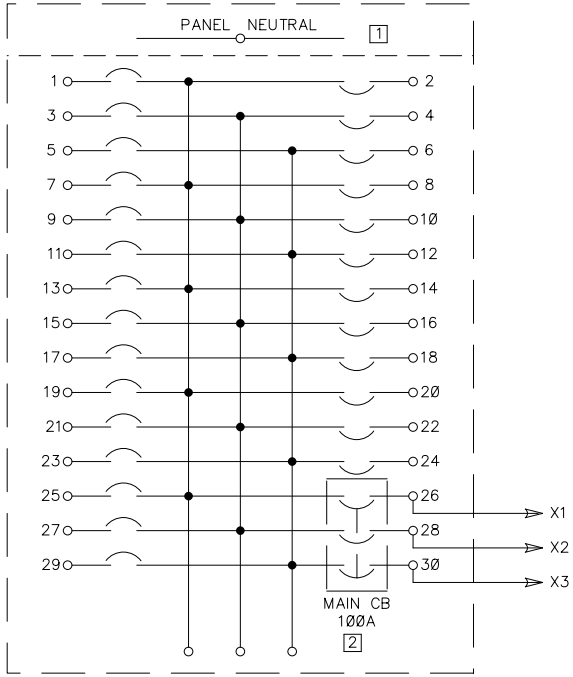


1 OTHER SIDE OF EACH CIRCUIT IS ALSO CONNECTED TO PANEL NEUTRAL.

2 THREE POLE PANEL CIRCUIT BREAKER IS REVERSE FED TO SERVE AS PANEL MAIN CIRCUIT BREAKER.

LIGHTING PANEL SUPPLIED WITH:  
 9 - 15A. - 1 POLE BREAKER(S)  
 9 - 20A. - 2 POLE BREAKER(S)

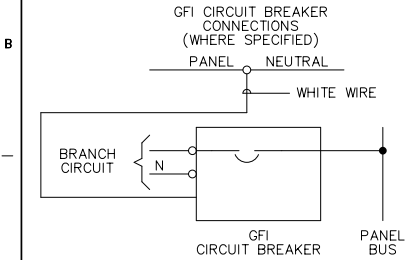

THIS LAYOUT IS TYPICAL OF A BUL 2193LE THREE PHASE, 4 WIRE, LIGHTING PANEL WITH 100A MAIN CIRCUIT BREAKER. ACTUAL LOCATION OF BRANCH BREAKERS IS DETERMINED BY MANUFACTURING.

- IT CONTAINS:
- 9 1-POLE 15A BRANCH BREAKERS
  - 9 2-POLE 20A BRANCH BREAKERS

References		BUL. 2193LE 3-PHASE		 <b>Rockwell Automation</b>
Revision		LIGHTING PANEL		
1	08/28/01	Dimensions Apply Before Surface Treatment		Sheet 1 Of 1
		Dimensions in Inches Tolerances Unless Otherwise Specified		Dwg Size C
		2 Place Decimal ±.02		2193LEWB007
		3 Place Decimal ±.005	Dr. _____ Date _____	
		Angles ±1	Chkd. _____ Date _____	
Refer. Book			Appd. _____ Date _____	