



A [1] OTHER SIDE OF EACH CIRCUIT IS ALSO CONNECTED TO PANEL NEUTRAL.

LIGHTING PANEL SUPPLIED WITH:  
 18 - 15A. - 1 POLE BREAKER(S)  
 9 - 15A. - 2 POLE BREAKER(S)  
 2 - 15A. - 3 POLE BREAKER(S)

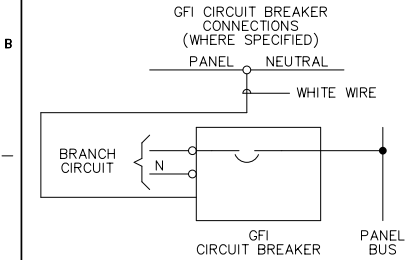

C REFER TO MANUFACTURERS INSTRUCTIONS FOR INSTALLATION AND TESTING.

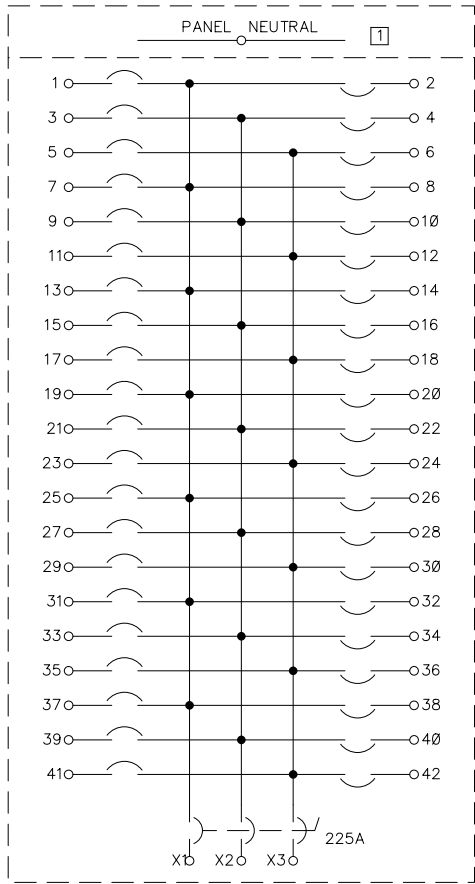

THIS LAYOUT IS TYPICAL OF A BUL 2193LE THREE PHASE, 4 WIRE, LIGHTING PANEL WITH 225A MAIN CIRCUIT BREAKER. ACTUAL LOCATION OF BRANCH BREAKERS IS DETERMINED BY MANUFACTURING.

- G IT CONTAINS:
- 18 1-POLE 15A BRANCH BREAKERS
  - 9 2-POLE 15A BRANCH BREAKERS
  - 2 3-POLE 15A BRANCH BREAKERS

H

References		BUL. 2193LE 3-PHASE		
Revision		LIGHTING PANEL		
1	08/28/01	Dimensions Apply Before Surface Treatment		Sheet 1 Of 1
		Dimensions in Inches Tolerances Unless Otherwise Specified		Dwg Size C
		2 Place Decimal ±.02	Dr.	Date
		3 Place Decimal ±.005	Chkd.	Date
		Angles ±1	Appd.	Date
Refer. Book				2193LEWB008