



- NOTE: (1) DIMENSIONS ARE NOT FOR MANUFACTURING PURPOSES.
 (2) DIMENSION SHOW APPLIES TO 2SF THROUGH 4SF UNITS ONLY.
 (3) DIMENSION SHOW APPLIES TO 1.5SF UNITS
 (4) TERMINAL BLOCK MOUNTING TABS ARE ONLY SUPPLIED WHEN OPTIONS -800 TO -805 ARE SPECIFIED. TABS ACCOMMODATE PART NUMBER 1492-EC85 (5 POLE) AND 1492-ED103 (3 POLE) TERMINAL BLOCKS.

TOP VIEW

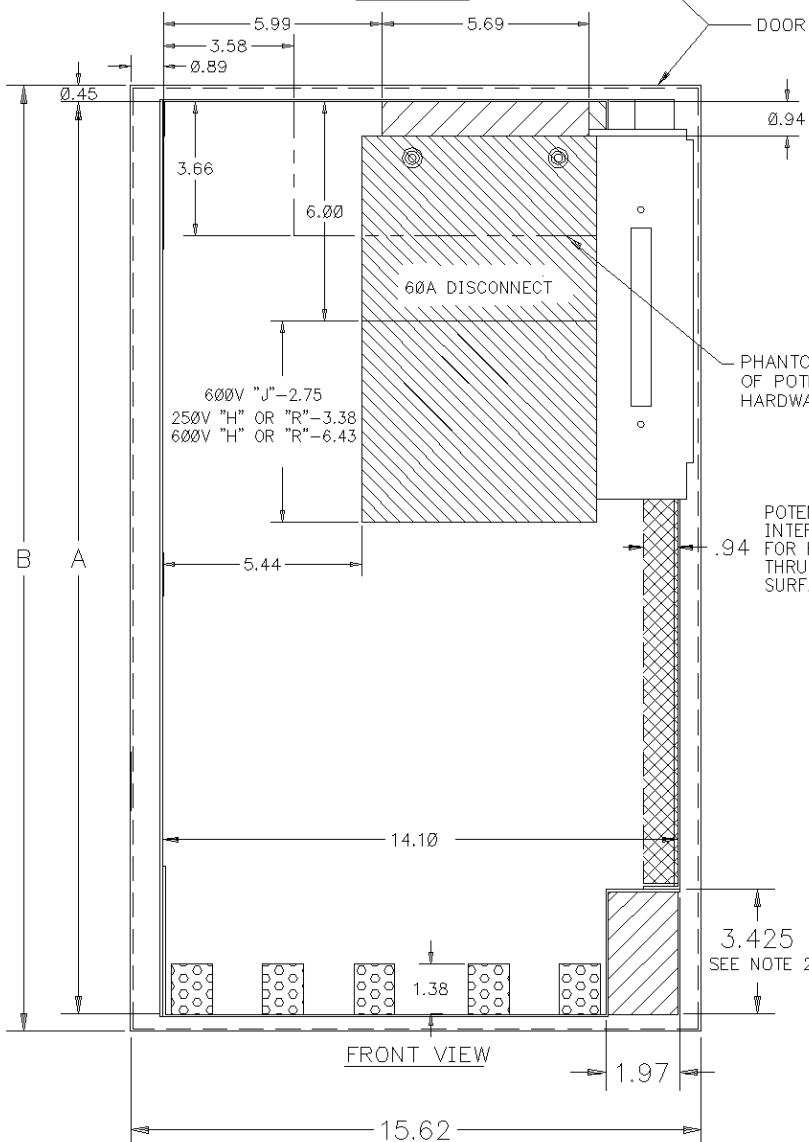

FRONT VIEW

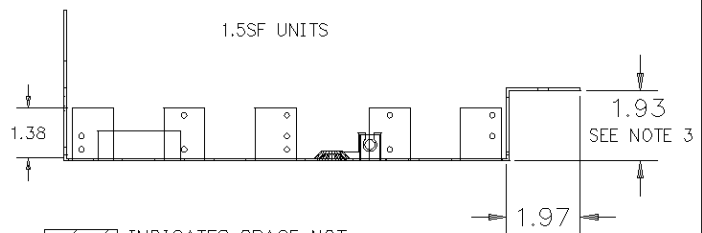

- INDICATES SPACE NOT AVAILABLE AS MOUNTING SURFACES.
- INDICATES POTENTIAL INTERFERENCE FOR HARDWARE THRU MOUNTING SURFACE.
- INDICATES POTENTIAL INTERFERENCE FROM TABS FORWARD OF MOUNTING SURFACE.
- INDICATES SPACE REQUIRED FOR DISCONNECT SWITCH

2100D UNIT INSERT W/60A DISC SWITCH (SEE NOTE 4)	4	51.12	51.906
	3.5	44.62	45.406
	3	38.12	38.906
	2.5	31.62	32.406
	2	25.12	25.906
	1.5	18.62	19.406
SPACE FACTOR	DIM A	DIM B	

References	
Revision	Dimensions Apply Before Surface Treatment
Release	Dimensions in Inches
1 10664-06	Tolerances Unless Otherwise Specified
	2 Place Decimal ±.02
	3 Place Decimal ±.005
	Angles ±1°
Refer. Book	

DIMENSION DRAWING	
FOR 2100D UNIT INSERT	
W/60A DISCONNECT SWITCH	
250V OR 600V "H-R" OR "J" FUSE	
Dr. S. Tietjen	Date 2-2-2006
Chkd. JIM KELLY	Date 2-22-06
Appd. T. SAUVE	Date 2-22-06

THIS PART	REV. LTR.
-01	1
<small>CONFIDENTIAL AND PROPRIETARY INFORMATION. THIS DOCUMENT CONTAINS CONFIDENTIAL AND PROPRIETARY INFORMATION OF ROCKWELL AUTOMATION, INC. AND MAY NOT BE USED, COPIED OR DISCLOSED TO OTHERS, EXCEPT WITH THE AUTHORIZED WRITTEN PERMISSION OF ROCKWELL AUTOMATION, INC.</small>	
Sheet	1 Of 1
Dwg Size	C
30101-539	

PARTS MUST CONFORM TO APPLICABLE ALLEN-BRADLEY CO. WORKMANSHIP STANDARD 40126-700